

# 25VNA Infinity® Variable Speed Heat Pump with Greenspeed™ Intelligence 2 to 5 Nominal Tons



## Product Data



**INFINITY™ SYSTEM**

Carrier's 25VNA with Greenspeed™ Intelligence is a breakthrough product providing up to 13 HSPF heating efficiency and up to 20.5 SEER cooling efficiency. The variable speed capacity control results in strong heating capacity as the outdoor temperature drops resulting in less reliance on auxiliary heat. Lower speed operation, when needed in cooling, for enhanced comfort and dehumidification.

This product has been designed and manufactured to meet Energy Star® criteria for energy efficiency when matched with appropriate coil components. Refer to the combination ratings in the Product Data for system combinations that meet Energy Star® guidelines.

**NOTE: Ratings contained in this document are subject to change at any time. Always refer to the AHRI directory ([www.ahridirectory.org](http://www.ahridirectory.org)) for the most up-to-date ratings information.**

### INDUSTRY LEADING FEATURES / BENEFITS

#### Energy Efficiency

- 16.8 - 20 SEER/11.4 - 16 EER/10.3 - 13.0 HSPF
- Microtube Technology™ refrigeration system
- Indoor air quality accessories available

#### Sound

- Sound level as low as 58 dBA in low speed .

#### Comfort

- Variable speed compressor with capacity range from 40-100%
- Air cooled Inverter variable speed drive
  - System requires Infinity Control with Greenspeed capability (SYSTXCCUID01-V or SYSTXCCUIZ01-V or newer)
- Energy Tracking capability with the Infinity Control Wall Control w/software version 13 or later (Energy Tracking has the ability to monitor and estimate the energy consumption of your Infinity® system.)

#### Reliability

- Puron® refrigerant - environmentally sound, won't deplete the ozone layer and low lifetime service cost.
- Front-seating service valves
- Greenspeed® Intelligence actively monitors critical system parameters
- High pressure switch
- Suction pressure transducer
- Electronic expansion valve (EXV) for heating, TXV for cooling
- Filter drier (field installed)
- External Muffler (field installed)
- Internal crankcase heater standard

#### Flexibility and installation:

- 2 control wires to outdoor unit
- Minimum and maximum airflow adjustments
- Compressor heating RPM control
- Hybrid Heat™ Dual Fuel capable

#### Durability

WeatherArmor Ultra™ protection package:

- Solid, Durable sheet metal construction
- Steel louver coil guard
- Baked-on, complete outer coverage, powder paint

#### Applications

- Long-line - up to 250 feet (76.2 m) total equivalent length, up to 200 feet (60.96 m) condenser above evaporator, or up to 80 ft. (24.38 m) evaporator above condenser (See Longline Guide for more information.)

## MODEL NUMBER NOMENCLATURE

1	2	3	4	5	6	7	8	9	10	11	12	13
N	N	A	A	A/N	N	N	N	A/N	A/N	A/N	N	N
2	5	V	N	A	0	3	6	A	0	0	3	0
Product Series	Product Family	Tier	Major Series	SEER	Cooling Capacity	Variations	Open	Open	Voltage	Minor Series		
25 = HP	V = VS HP	N = Infinity Series	A = Puron	20 = SEER	1,000 Btuh (nominal)	A = Standard	0 = Not Defined	0 = Not Defined	3 = 208/230-1	0, 1, 2...		



Use of the AHRI Certified TM Mark indicates a manufacturer's participation in the program. For verification of certification for individual products, go to [www.ahridirectory.org](http://www.ahridirectory.org).



ISO 9001  
QMI-SAI Global



This product has been designed and manufactured to meet Energy Star® criteria for energy efficiency when matched with appropriate coil components. However, proper refrigerant charge and proper air flow are critical to achieve rated capacity and efficiency. Installation of this product should follow all manufacturing refrigerant charging and air flow instructions. **Failure to confirm proper charge and air flow may reduce energy efficiency and shorten equipment life.**



## STANDARD FEATURES

FEATURES	Unit Size – Voltage, Series			
	24–30	36–30	48–30	60–30
Puron Refrigerant	X	X	X	X
Louvered Coil Guard	X	X	X	X
Field Installed Filter Drier / External Muffler	X	X	X	X
Front Seating Service Valves	X	X	X	X
Internal Pressure and Temperature Protection	X	X	X	X
Long Line capability	X	X	X	X
Suction Pressure Transducer	X	X	X	X
High Pressure Switch	X	X	X	X
Crankcase Heater	X	X	X	X
Low ambient cooling down to 0°F capability with Infinity Control	X	X	X	X
Utility Interface Connections	X	X	X	X
Enhanced Diagnostics with Infinity Control	X	X	X	X
Energy Tracking Capability with the Infinity® Wall Control (requires software version 13 or later)	X	X	X	X
Deluxe Sound Blanket	X	X	X	X
Outdoor Air Temperature Sensor	X	X	X	X

X = Standard

# REFRIGERANT PIPING LENGTH LIMITATIONS

## Maximum Line Lengths:

The maximum allowable total equivalent length for heat pumps varies depending on the vertical separation. See the tables below for allowable lengths depending on whether the outdoor unit is on the same level, above or below the indoor unit.

### Maximum Line Lengths for Heat Pump Applications

	MAXIMUM ACTUAL LENGTH ft (m)	MAXIMUM EQUIVALENT LENGTH† ft (m)	MAXIMUM VERTICAL SEPARATION ft (m)
Units on equal level	200 (61)	250 (76.2)	N/A
Outdoor unit ABOVE indoor unit	200 (61)	250 (76.2)	200 (61)
Outdoor unit BELOW indoor unit	See Table 'Maximum Total Equivalent Length: Outdoor Unit BELOW Indoor Unit'		

† Total equivalent length accounts for losses due to elbows or fitting. See the Long Line Guideline for details.

### Maximum Total Equivalent Length† - Outdoor Unit BELOW Indoor Unit

Size	Liquid Line Diameter w/ TXV	HP with Puron® Refrigerant – Maximum Total Equivalent Length† Vertical Separation ft (m) Outdoor unit BELOW indoor unit;						
		0–20 (0 – 6.1)	21–30 (6.4 – 9.1)	31–40 (9.4 – 12.2)	41–50 (12.5 – 15.2)	51–60 (15.5 – 18.3)	61–70 (18.6 – 21.3)	71–80 (21.6 – 24.4)
024 HP with Puron	3/8	250*	250*	250*	250*	250*	250*	250*
036 HP with Puron	3//8	250*	250*	250*	250*	250*	250*	250*
048 HP with Puron	3/8	250*	250*	250*	250*	230	160	--
060 HP with Puron	3/8	250*	225*	190	150	110	--	--

\* Maximum actual length not to exceed 200 ft (61 m)

† Total equivalent length accounts for losses due to elbows or fitting. See the Long Line Guideline for details.

-- = outside acceptable range

## LONG LINE APPLICATIONS

An application is considered Long Line when the refrigerant level in the system requires the use of accessories to maintain acceptable refrigerant management for systems reliability. Defining a system as long line depends on the liquid line diameter, actual length of the tubing, and vertical separation between the indoor and outdoor units.

For Heat Pump systems, the chart below shows when an application is considered Long Line. Beyond these lengths, long line accessories are required:

### HP WITH PURON® REFRIGERANT LONG LINE DESCRIPTION ft (m) Beyond these lengths, long line accessories are required

Liquid Line Size	Units On Same Level	Outdoor Below Indoor	Outdoor Above Indoor
3/8	80 (24.4)	20 (6.1) vertical or 80 (24.4) total	80 (24.4)

Note: See Long Line Guideline for details

## COOLING CAPACITY LOSS TABLE

Nominal Size (Btuh)	Line OD (in.)	25VNA Cooling Capacity Loss (%)										
		Total Equivalent Line Length (ft)										
		25	50	75	80	100	125	150	175	200	225	250
24000	5/8	0.5	1.2	1.8	1.9	2.4	3.0	3.7	4.3	4.9	5.5	6.2
	3/4	0.1	0.4	0.6	0.7	0.8	1.1	1.3	1.5	1.8	2.0	2.3
	7/8	0.0	0.1	0.3	0.3	0.4	0.5	0.6	0.7	0.8	1.0	1.1
36000	5/8	1.1	2.4	3.7	4.0	5.0	6.3	7.7	9.0	10.3	11.6	12.9
	3/4	0.3	0.8	1.3	1.4	1.8	2.3	2.8	3.2	3.7	4.2	4.7
	7/8	0.0	0.3	0.5	0.6	0.8	1.0	1.3	1.5	1.8	2.0	2.3
48000	3/4	0.7	1.6	2.4	2.6	3.2	4.1	4.9	5.7	6.5	7.4	8.2
	7/8	0.3	0.7	1.1	1.2	1.6	2.0	2.4	2.8	3.2	3.6	4.1
	1 1/8	0.0	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9	1.0
60000	3/4	1.0	2.3	3.5	3.8	4.8	6.0	7.3	8.5	9.8	11.0	12.3
	7/8	0.4	1.0	1.7	1.8	2.3	2.9	3.5	4.2	4.8	5.4	6.0
	1 1/8	0.0	0.1	0.3	0.4	0.5	0.7	0.8	1.0	1.2	1.4	1.5

Rating Line Size in **Bold**

TE Length Greater than 80 ft requires Long Line Accessory Liquid Line Solenoid

## EQUIPMENT SIZING GUIDELINES

If primary load is cooling, size the same as any other air conditioning system. If primary load is heating, use the chart below for maximum size for heating.

### MAXIMUM RECOMMENDED EQUIPMENT SIZE - HEATING

COOLING LOAD (tons)	MAXIMUM RECOMMENDED EQUIPMENT SIZE FOR HEATING*
2	36
2.5	36
3	48
3.5	60
4	60
5	60

\* Make sure duct work is capable of delivering required airflow . Make sure combination rating exists for desired combination.

## MIN/MAX AIRFLOW TABLES

The indoor airflow delivered by this system varies significantly based on outdoor temperature, indoor unit combination, and system demand. The airflows on these tables are for duct design considerations. Duct systems capable of these ranges will ensure

the system will deliver full capacity at all outdoor temperatures. Minimum and maximum airflows can be adjusted from these numbers in the Infinity Control Heat Pump Setup screen.

Cooling – Comfort Mode			Minimum Cooling (Dehum or Zoning)
Size	Max Capacity	Min Capacity	
24	726	651	398
36	1168	651	398
48	1394	1186	693
60	1650	1186	693

Cooling – Efficiency Mode		
Size	Max Capacity	Min Capacity
24	949	830
36	1334	830
48	1593	1355
60	1885	1355

Heating – Comfort Mode		
Size	Max Capacity	Min Capacity
24	698	440
36	1140	451
48	1354	751
60	1354	751

Heating – Efficiency Mode		
Size	Max Capacity	Min Capacity
24	900	750
36	1350	750
48	1600	890
60	1750	901

## PHYSICAL DATA

UNIT SIZE SERIES	24-30	36-30	48-30	60-30
Operating Weight lb (kg)	324 (147)	324 (147)	334 (152)	334 (152)
Shipping Weight lb (kg)	367 (167)	367 (167)	375 (170)	375 (170)
Compressor Type	Variable Speed Scroll			
REFRIGERANT	Puron® (R-410A)			
Control	TXV (Puron® Hard Shutoff)			
Charge lb (kg)	13.12 (5.95)	13.12 (5.95)	13.30 (6.03)	13.30 (6.03)
Outdoor Htg Exp. Device	EXV	EXV	EXV	EXV
COND FAN	Forward Swept Propeller Type, Direct Drive			
Air Discharge	Vertical			
Air Qty (CFM)	2700	4269	4350	5000
Motor HP	1/3	1/3	1/3	1/3
Motor RPM	500-900	500-900	500-900	500-900
COND COIL				
Face Area (Sq ft)	30.25	30.25	30.25	30.25
Fins per In.	20	20	20	20
Rows	2	2	2	2
Circuits	8	8	9	9
VALVE CONNECT. (In. ID)				
Vapor	7/8	7/8	7/8	7/8
Liquid	3/8			
REFRIGERANT TUBES (In. OD)				
Rated Vapor*	7/8	7/8	1-1/8	1-1/8
Max Liquid Line	3/8			

\* Units are rated with 25 ft (7.6 m) of lineset length. See Vapor Line Sizing and Cooling Capacity Loss table when using other sizes and lengths of lineset.

**Note:** See unit Installation Instruction for proper installation.

## ACCESSORIES

KIT NUMBER	KIT NAME	24-30	36-30	48-30	60-30
KHAEM0101EMI	ELECTRO-MAGNETIC INTERFERENCE KIT	X	X	X	X
KHALS0401LLS	SOLENOID VALVE	X	X	X	X
KHASS0606MPK*	SNOW STAND	X	X	X	X
KSASF0101AAA	SUPPORT FEET	X	X	X	X
KSATX0301PUR	TXV	X	X		
KSATX0401PUR	TXV			X	
KSATX0501PUR	TXV				X
STANDARD	CRANKCASE HEATER	S	S	S	S

x = Accessory S = Standard \* Available from RCD

## CONTROLS

SYSTXCCITN01	Infinity Touch Control (non-Wi-Fi)
SYSTXCCITW01	Infinity Touch Control with Wi-Fi & Wireless Access Point
SYSTXCCUID01-V	Infinity Control Deluxe 7-Day Programmable (Wall-mounted system control.)
SYSTXCCUIZ01-V	Infinity Control Deluxe Zoning 7-Day Programmable (Wall-mounted control for a multi-zone system.)
SYSTXCC4ZC01	Infinity 4-Zone Damper Control Module (Wall-mounted control for a four-zone system.)
SYSTXCCSMS01	Infinity Smart Sensor (Optional wall control used to monitor temperature and/or fan control in an individual zone.)
SYSTXCCRRS01	Infinity Remote Room Sensor (Monitors temperature in an individual zone.)
SYSTXCCRCT01 or SYSTXCCRWF01	Infinity System Access Module (Hardware for wireless access and control via internet.)
SYSTXCCNIM01	Infinity Network Interface Module (Connects Heat Recovery and Energy Recovery Ventilators on non-zoning applications.)
SYSTXX0LBP01	Decorative Back Plate for Infinity Control (Decorative wall plate.)

## ACCESSORY USAGE GUIDELINE

ACCESSORY	REQUIRED FOR LOW-AMBIENT COOLING APPLICATIONS (Below 55°F/12.8°C)	REQUIRED FOR LONG LINE APPLICATIONS* (Over 80 ft/24.38 m)	REQUIRED FOR SEA COAST APPLICATIONS (Within 2 miles/3.22 km)
Crankcase Heater	Standard	Standard	Standard
Evaporator Freeze Protection	Standard with Infinity™ Control	No	No
Liquid-Line Solenoid Valve	No	Yes	No
Low-Ambient Control	Standard with Infinity Control	No	No
Puron Refrigerant Balance Port Hard-ShutOff TXV	Yes†	Yes†	Yes†
Support Feet	Recommended	No	Recommended
Winter Start Control	Standard with Infinity Control	No	No

\* For tubing set lengths between 80 and 200 ft. (24.38 and 60.96 m) horizontal or 20 ft. (6.10 m) vertical differential (total equivalent length), refer to the Long Line Guideline—Air Conditioners and Heat Pumps using Puron® Refrigerant.

† Required on all indoor units. Standard on all new Greenspeed™ compatible fan coils and furnace coils.

### Accessory Description and Usage (Listed Alphabetically)

#### 1. Compressor Start Assist

The inverter drive gently starts the variable speed compressor at all times. No other start device is compatible with this unit.

#### 2. Crankcase Heater

Compressor motor winding resistance heater which is internal to compressor to keep the lubricant warm during off cycles. Improves compressor lubrication on restart and minimizes the chance of liquid slugging.

Usage:

Used in low ambient cooling applications.

Used in long line applications.

#### 3. Liquid-Line Solenoid Valve (LLS)

An electrically operated shutoff valve which stops and starts refrigerant liquid flow in response to compressor operation. It is to be installed at the outdoor unit to control refrigerant off cycle migration in the heating mode.

Usage Guideline:

An LLS is required in all long line heat pump applications to control refrigerant off cycle migration in the heating mode. See Long Line Guideline.

Suggested for all commercial applications.

#### 4. Snow Stand

Coated wire rack which supports unit 18 in. (457.2 mm) above mounting pad to allow for drainage from unit base.

Usage Guideline:

Suggested in the following applications:

Heat pump installations in heavy snowfall areas.

Heat pump installations in snow drift locations.

Heat pump installations in areas of prolonged subfreezing temperatures.

All commercial installations.

#### 5. Thermostatic Expansion Valve (TXV) Bi-Flow

A modulating flow-control valve which meters refrigerant liquid flow rate into the evaporator in response to the superheat of the refrigerant gas leaving the evaporator.

Usage Guideline:

Accessory required to meet AHRI rating and system reliability, where indoor not equipped.

Required in all heat pump applications designed with Puron refrigerant.

#### 6. Electro-Magnetic Interference Kit

Usage Guideline:

May be required to address radio frequency interference for equipment, such as HAM radios, operating between 6 and 30 MHz.

## ELECTRICAL DATA

UNIT SIZE – VOLTAGE, SERIES	V/PH	OPER VOLTS*		COMPR		FAN	MCA	MIN WIRE SIZE†	MIN WIRE SIZE†	MAX LENGTH ft (m)‡	MAX LENGTH ft (m)‡	MAX FUSE* * or CKT BRK AMPS
		MAX	MIN	LRA	RLA	FLA		60°C	75°C	60°C	75°C	
24–30	208–230–1	253	197	24	16.5	2.9	23.5	12	12	52 (15.9)	50 (16.2)	30
36–30				24	16.5	2.9	23.5	12	12	52 (15.9)	50 (16.2)	40
48–30				42	27.0	2.9	36.6	8	8	84 (25.6)	80 (24.3)	50
60–30				42	27.0	2.9	36.6	8	8	84 (25.6)	80 (24.3)	50

\* Permissible limits of the voltage range at which the unit will operate satisfactorily

† If wire is applied at ambient greater than 30°C, consult table 310–16 of the NEC (NFPA 70). The ampacity of non–metallic–sheathed cable (NM), trade name ROMEX, shall be that of 60°C conditions, per the NEC (NFPA 70) Article 336–26. If other than uncoated (no–plated), 60 or 75°C insulation, copper wire (solid wire for 10 AWG or smaller, stranded wire for larger than 10 AWG) is used, consult applicable tables of the NEC (NFPA 70).

‡ Length shown is as measured 1 way along wire path between unit and service panel for voltage drop not to exceed 2%.

\*\* Time–Delay fuse.

FLA – Full Load Amps

LRA – Locked Rotor Amps

MCA – Minimum Circuit Amps

RLA – Rated Load Amps

NOTE: Control circuit is 24–V on all units and requires external power source. Copper wire must be used from service disconnect to unit.

All motors/compressors contain internal overload protection.

Complies with 2010 requirements of ASHRAE Standards 90.1

## SOUND POWER LEVEL (dBA)

Unit Size – Voltage, Series	Typical Octave Band Spectrum (without tone adjustment)	Min Speed Cooling	Max Speed Cooling	*Min Speed Heating	*Max Speed Heating
024–30	Freq (Hz)	1800 RPM	3200 RPM	1800 RPM	5700 RPM
	125	62.0	63.0	63.0	73.5
	250	57.0	56.5	61.5	63.0
	500	54.5	57.5	58.5	66.0
	1000	52.0	58.0	54.5	63.5
	2000	47.5	54.0	51.5	64.5
	4000	44.5	48.0	48.0	59.5
	8000	52.5	54.5	54.0	61.5
	Sound Rating (dBA)	58	63	62	71
036–30	Freq (Hz)	1800 RPM	4500 RPM	1800 RPM	6850**
	125	62.0	64.5	63.0	67.0
	250	57.0	60.5	61.5	67.5
	500	54.5	61.0	58.5	69.0
	1000	52.0	61.0	54.5	67.0
	2000	47.5	56.0	51.5	67.0
	4000	44.5	51.0	48.0	63.0
	8000	52.5	54.5	54.0	61.5
	Sound Rating (dBA)	58	65	62	75
048–30	Freq (Hz)	1800 RPM	3450 RPM	1800 RPM	6300**
	125	62.0	70.0	66.0	73.5
	250	60.5	67.5	63.0	69.5
	500	56.0	67.0	63.0	73.5
	1000	59.0	63.0	58.0	72.0
	2000	54.0	60.0	53.5	66.5
	4000	52.5	56.0	50.0	65.5
	8000	58.5	58.5	57.0	63.0
	Sound Rating (dBA)	65	70	64	76
060–30	Freq (Hz)	1800 RPM	4250 RPM	1800 RPM	6300**
	50	62.0	65.0	66.0	73.5
	100	60.5	67.5	63.0	69.5
	200	56.0	67.5	63.0	73.5
	400	59.0	66.5	58.0	72.0
	800	54.0	61.0	53.5	66.5
	1600	52.5	60.5	50.0	65.5
	3150	58.5	59.0	57.0	63.0
	Sound Rating (dBA)	65	72	64	76

NOTE: Tested in compliance with AHRI 270–2008 but not listed with AHRI.

\* 024 & 036 tested at 44°F Outdoor Air Temperature. 048 & 060 tested at 40°F

\*\*Testable RPM limited by outdoor temp. Max unit RPM is 6500 for the 4 ton and 7000 for the 3 and 5 ton.


## CHARGING SUBCOOLING (TXV-TYPE EXPANSION DEVICE)

UNIT SIZE – VOLTAGE, SERIES	REQUIRED SUBCOOLING °F (°C) – See UI
24–30	Subcooling recommendation displayed on UI in Charging Mode must be followed
36–30	
48–30	
60–30	

# DIMENSIONS

UNIT	SERIES	ELECTRICAL CHARACTERISTICS		A		B		C		D		E		F		G		H		I		J		K		OPERATING WEIGHT		SHIPPING WEIGHT		SHIPPING LENGTH / WIDTH (Sq.)		SHIPPING HEIGHT		
		INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	INCH	MM	Lbs	Kgs	Lbs	Kgs	INCH	MM	INCH	MM	
25VNA024A030040	0	Y	N	N	35	889.0	43 13/16	1112.6	7/8	22.2	6 9/16	166.1	28 7/16	722.8	9 1/8	231.3	1 1/8	28.2	3 13/16	97.4	16 1/4	412.8	16 1/4	412.8	21 1/4	539.8	324	147.0	367	166.5	37 1/8	943.1	50 3/16	1274.9
25VNA036A030040	0	Y	N	N	35	889.0	43 13/16	1112.6	7/8	22.2	6 9/16	166.1	28 7/16	722.8	9 1/8	231.3	1 1/8	28.2	3 13/16	97.4	16 1/4	412.8	16 1/4	412.8	21 1/4	539.8	324	147.0	367	166.5	37 1/8	943.1	50 3/16	1274.9
25VNA048A030040	0	Y	N	N	35	889.0	43 13/16	1112.6	7/8	22.2	6 9/16	166.1	28 7/16	722.8	9 1/8	231.3	1 1/8	28.2	3 13/16	97.4	16 1/4	412.8	16 1/4	412.8	21 1/4	539.8	334	151.5	375	170.1	37 1/8	943.1	50 3/16	1274.9
25VNA060A030040	0	Y	N	N	35	889.0	43 13/16	1112.6	7/8	22.2	6 9/16	166.1	28 7/16	722.8	9 1/8	231.3	1 1/8	28.2	3 13/16	97.4	16 1/4	412.8	16 1/4	412.8	21 1/4	539.8	334	151.5	375	170.1	37 1/8	943.1	50 3/16	1274.9

NOTES:  
1. CENTER OF GRAVITY

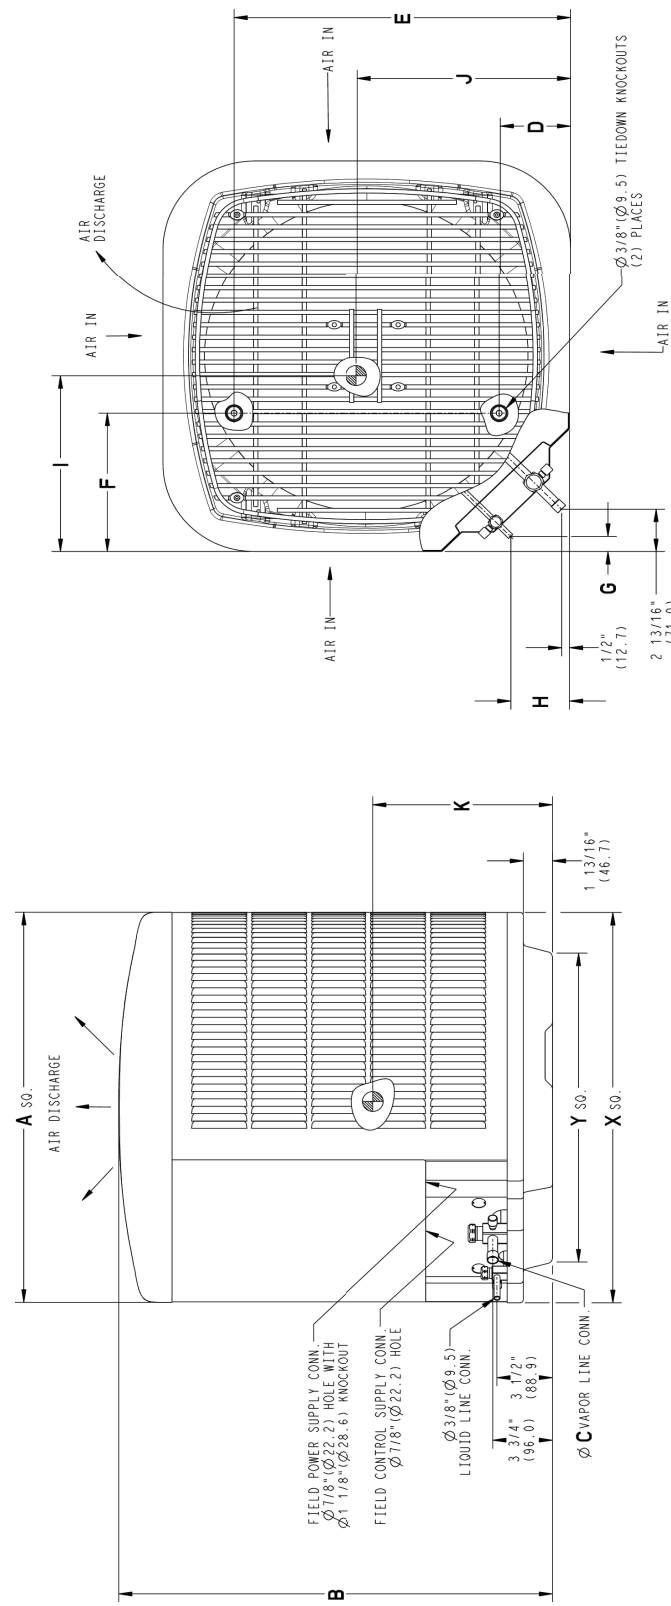

UNIT SIZE	"X" MINIMUM GROUND MOUNTING PAD APPLICATION DIMENSIONS		"Y" MINIMUM ROOF-TOP MOUNTING PAD APPLICATION DIMENSIONS	
	INCH	MM	INCH	MM
-	23 1/8	587.3	17 7/8	454.6
-	25 3/4	654.0	20 7/16	518.5
-	31 3/16	792.5	22 15/16	583.2
24.96.48.60	35	889.0	26 3/4	679.7

NOTE: ALL DIMENSIONS IN INCH (MM)


U.S. ECCN: Not Subject to Regulation (N.S.R.)

SDS025-4 REV. C




25VNA BALANCE POINT WORKSHEET

25VNA024 BALANCE POINT WORK SHEET  
(MINIMUM & MAXIMUM HEATING CAPACITIES)

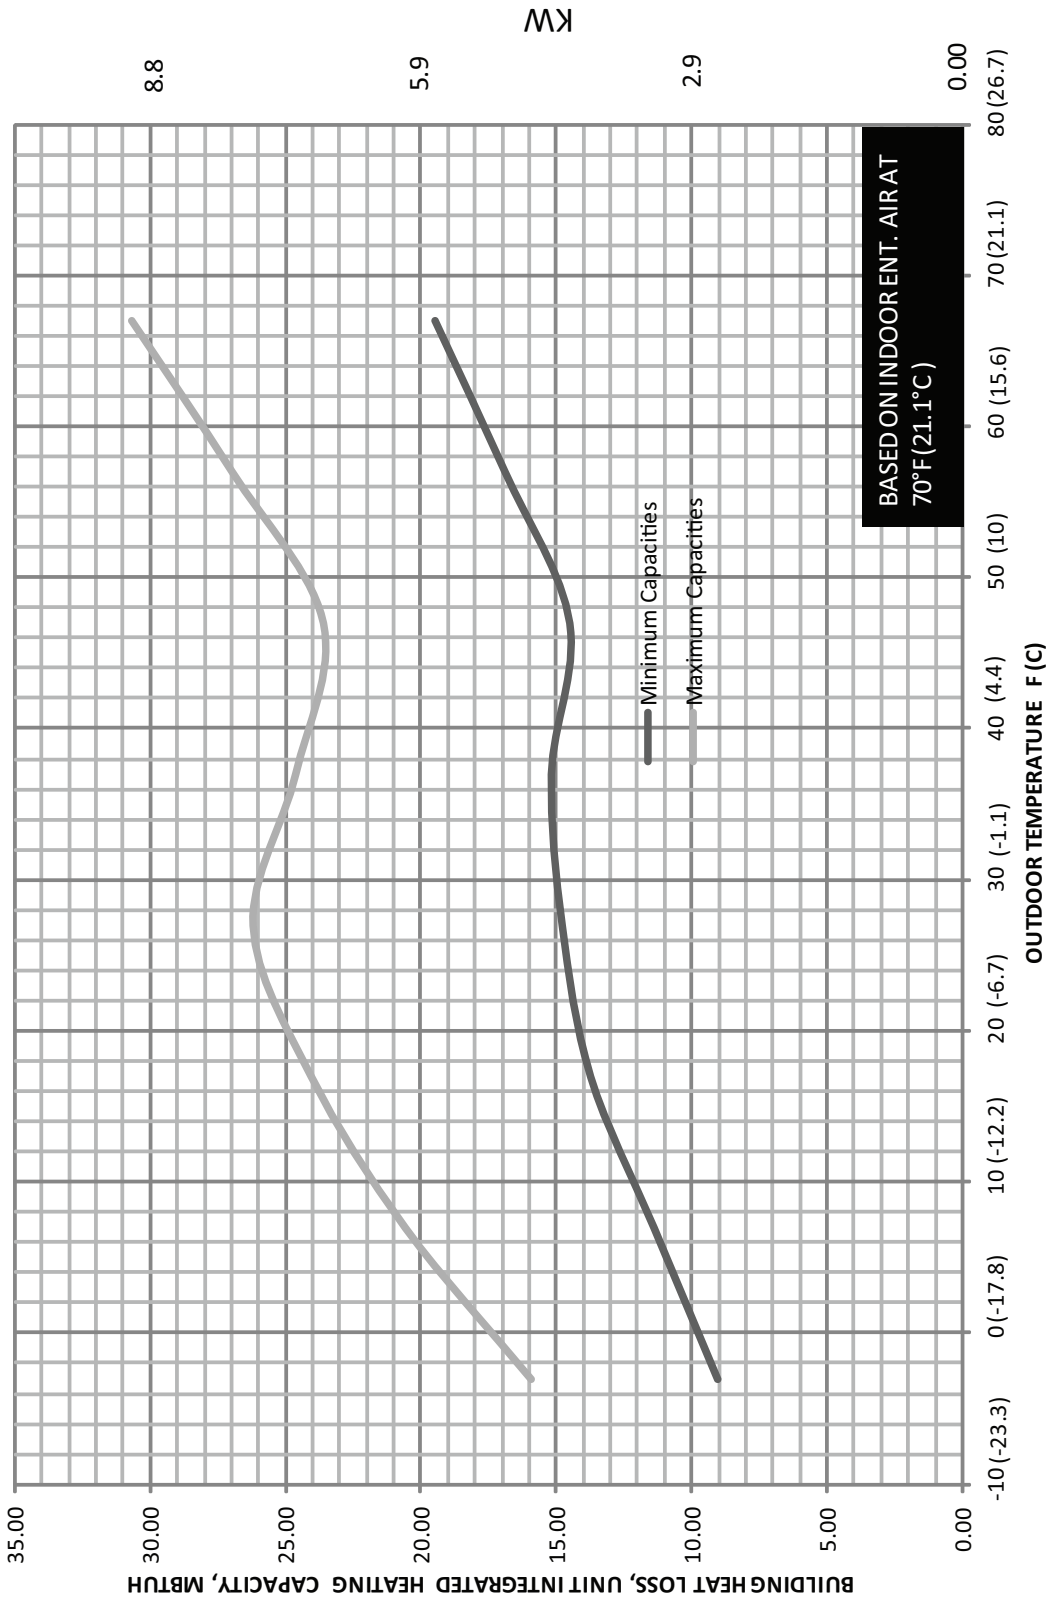


25VNA BALANCE POINT WORKSHEET CONT.

**25VNA036 BALANCE POINT WORKSHEET  
(MINIMUM & MAXIMUM DELIVERABLE HEATING CAPACITIES)**

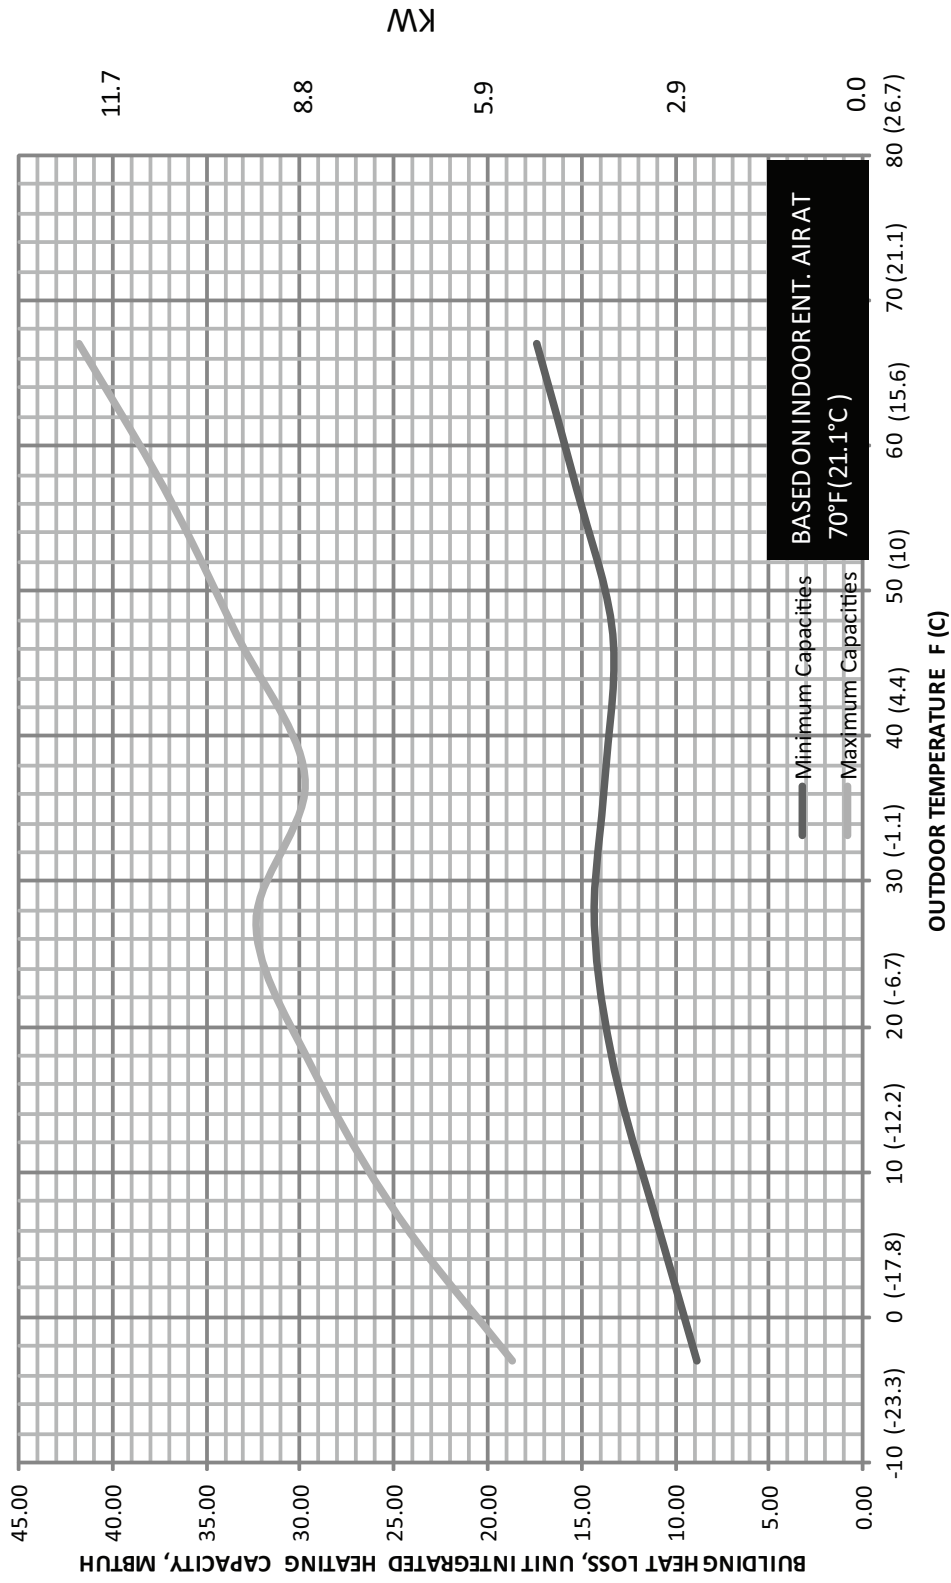


25VNA BALANCE POINT WORKSHEET CONT.

25VNA048 BALANCE POINT WORK SHEET  
 MINIMUM AND MAXIMUM HEATING CAPACITIES

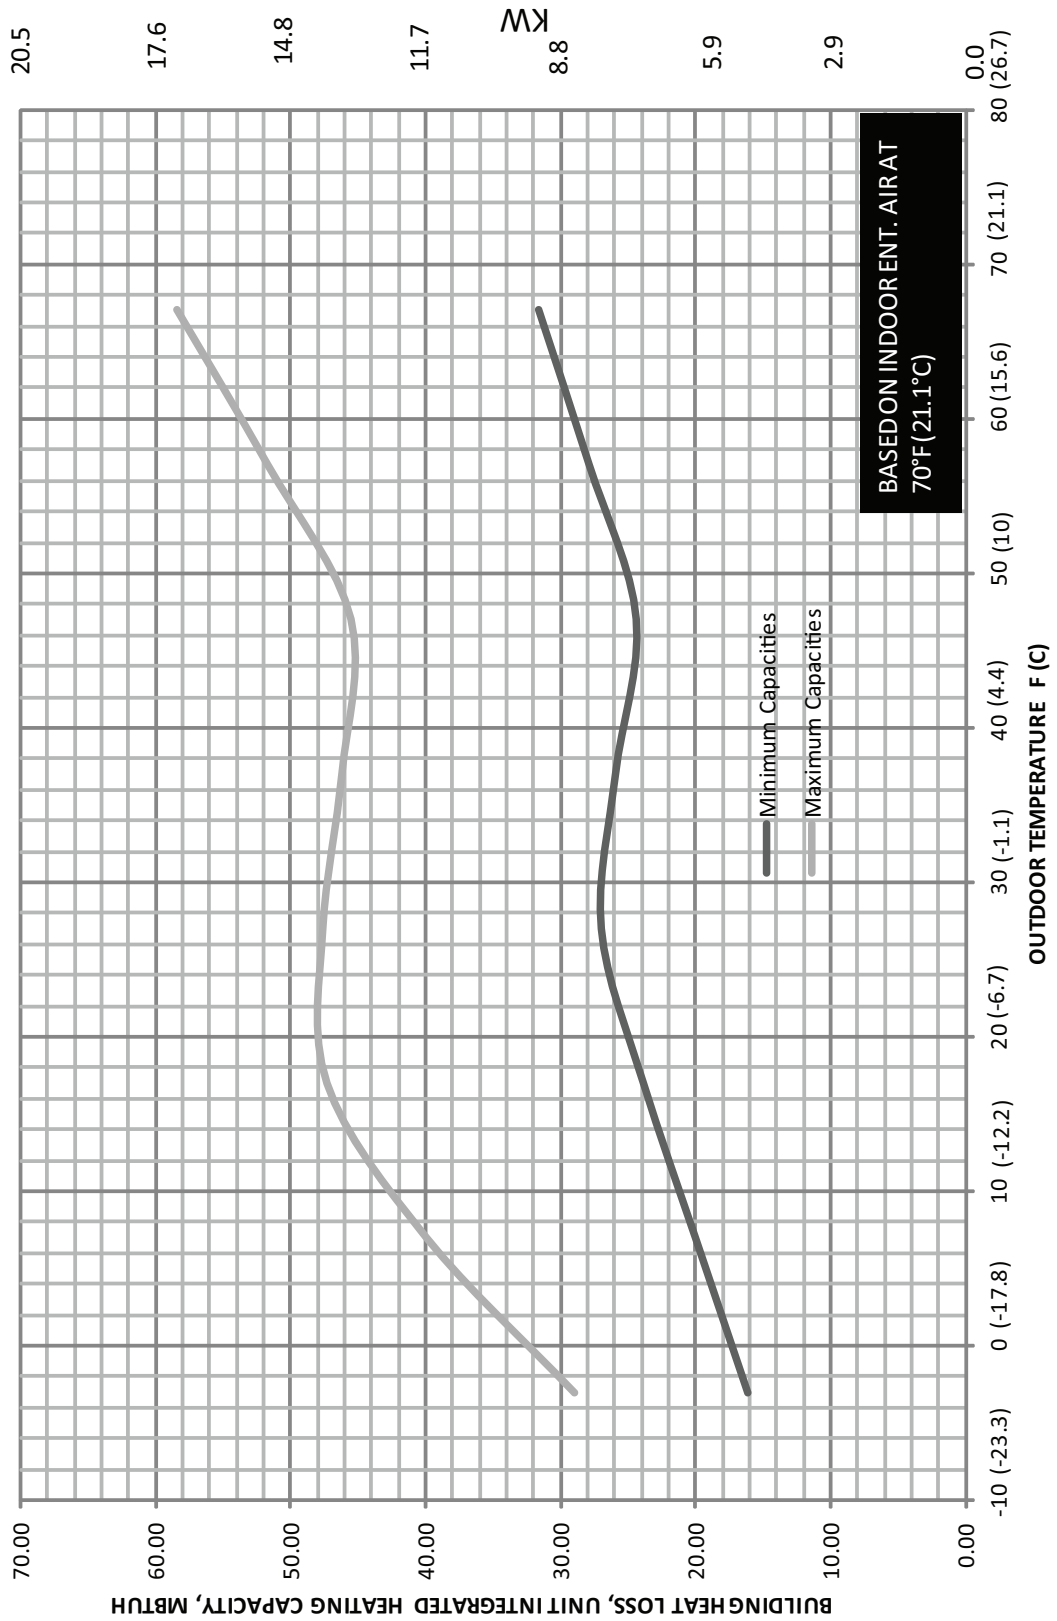


25VNA BALANCE POINT WORKSHEET CONT.

25VNA060 BALANCE POINT WORK SHEET  
 MINIMUM AND MAXIMUM HEATING CAPACITIES

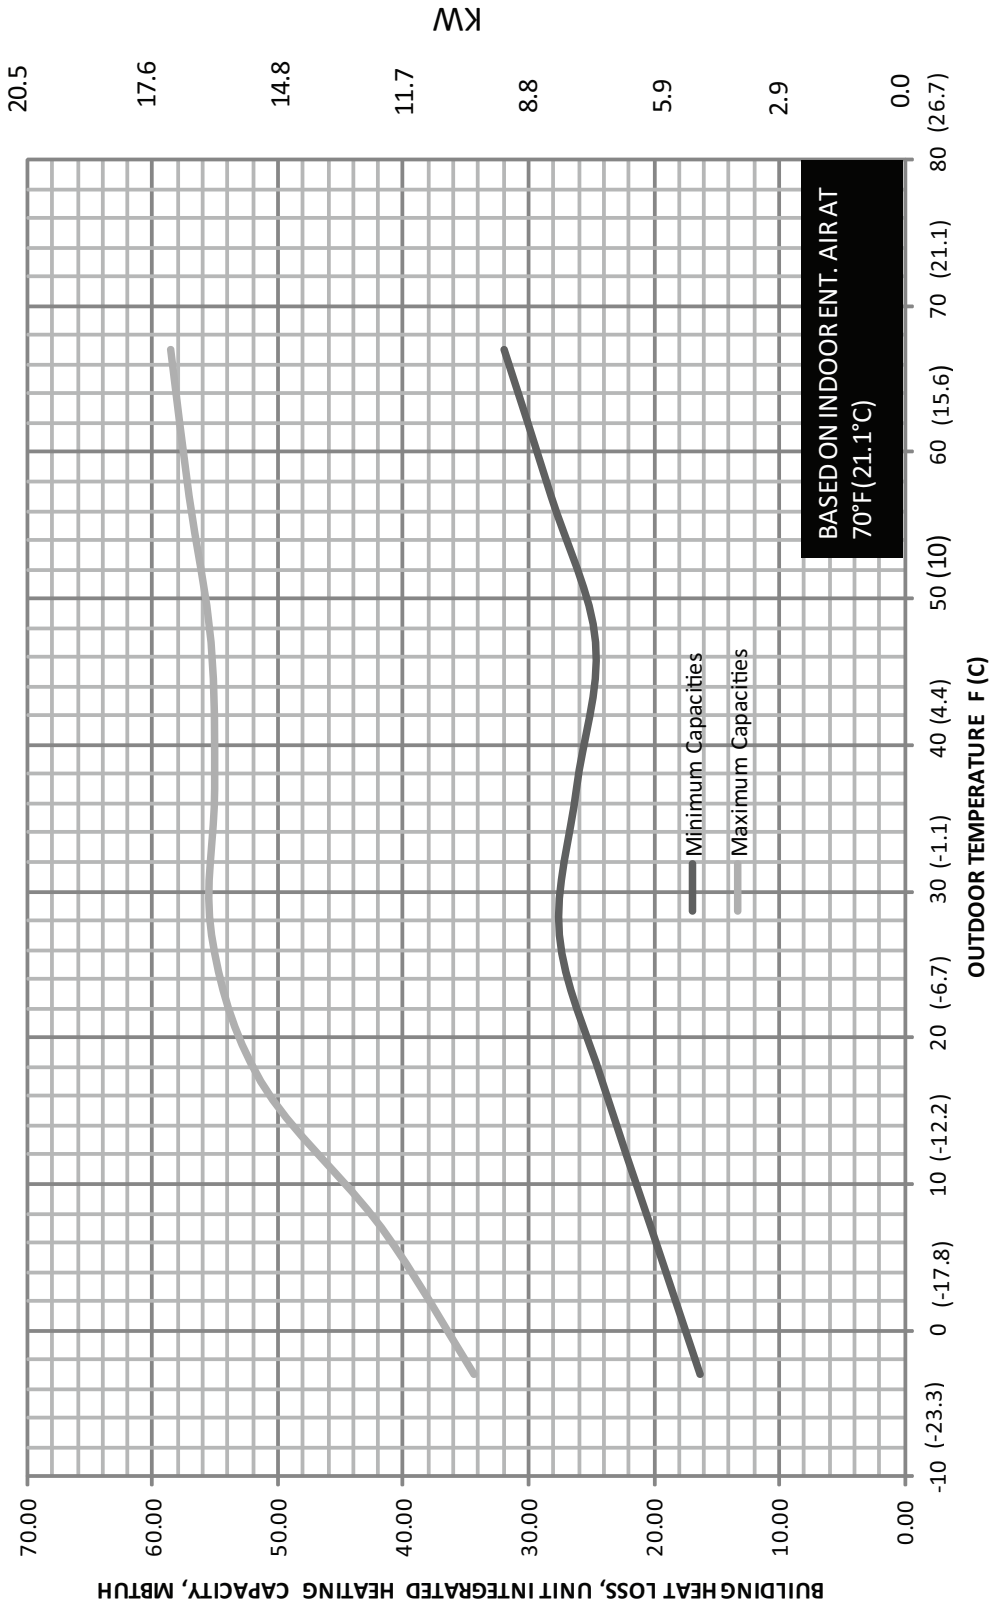

# CLEARANCES

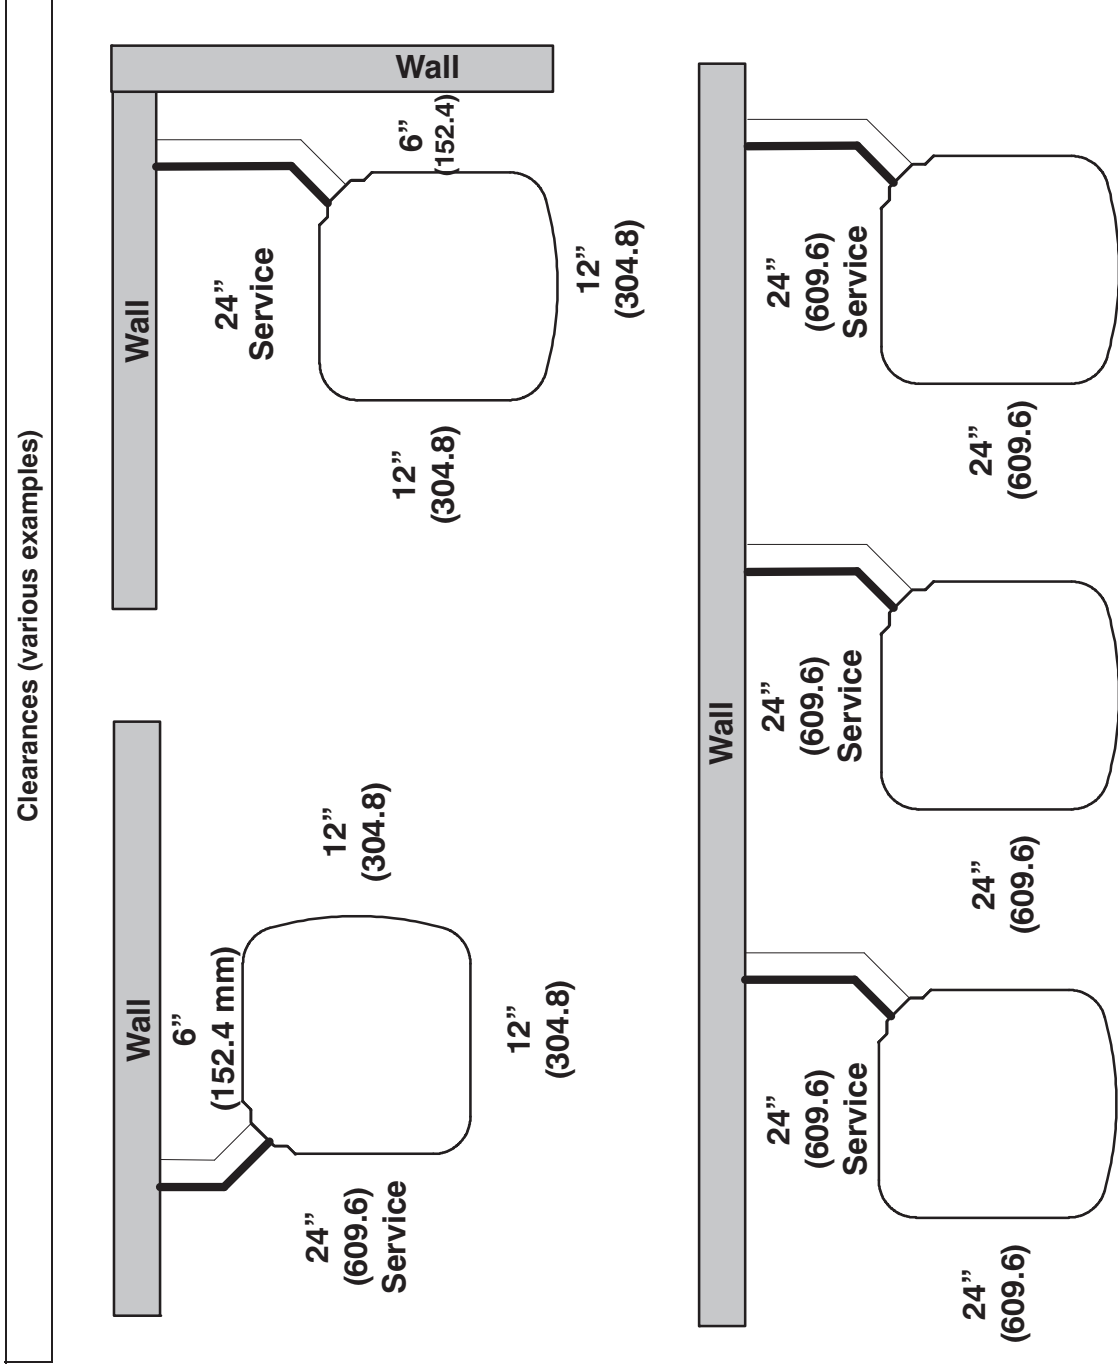

**Note: Numbers in ( ) = mm**

**IMPORTANT:** When installing multiple units in an alcove, roof well, or partially enclosed area, ensure there is adequate ventilation to prevent re-circulation of discharge air.

## TESTED AHRI COMBINATION RATINGS\*

NOTE: Ratings contained in this document are subject to change at any time.

For AHRI ratings certificates, please refer to the AHRI directory [www.ahridirectory.org](http://www.ahridirectory.org)  
 Additional ratings and system combinations can be accessed via the Carrier database at: [http://cactaxcredits.info/carrier-ratings/ac\\_ratings\\_srch.php](http://cactaxcredits.info/carrier-ratings/ac_ratings_srch.php)  
 Equipment performance calculator can be accessed at: <http://rpmob.wrightsoft.com/>

Model Number	Coil Model Number	Furnace Model Number	Clg. Cap. High	Clg. Cap. Low	EER	SEER	ID CFM		High Temp		Low Temp	
							High	Low	E Capacity	E COP	H Capacity	H COP
25VNA024A**30	FE4ANB006+UI		25,200	19,200	16.0	20.5	900	650	23,600	4.70	24,800	2.54
25VNA036A**30	FE4ANB006+UI		35,000	23,200	14.5	20.5	1200	875	33,400	4.40	31,600	2.54
25VNA048A**30	FE4ANB006+UI		47,500	34,800	13.5	18.3	1500	1100	45,500	4.12	47,500	2.22
25VNA060A**30	FE4ANB006+UI		56,000	38,000	12.7	18.0	1500	1100	55,500	3.86	52,500	2.22

\* Ratings are net values reflecting the effects of circulating fan heat. Supplemental electric heat is not included. Ratings are based on:

**Cooling Standard:** 80°F (27°C) db 67°F (19°C) wb indoor entering air temperature and 95°F (35°C) db air entering outdoor unit.  
**High-Temp Heating Standard:** 70°F (21°C) db indoor entering air temperature and 47°F (8°C) db 43°F (6°C) wb air entering outdoor unit.  
**Low-Temp Heating Standard:** 70°F (21°C) db indoor entering air temperature and 17°F (-8°C) db 15°F (-9°C) wb air entering outdoor unit.  
**COP** — Coefficient of Performance  
**EER** — Energy Efficiency Ratio  
**HSPF** — Heating Seasonal Performance Factor  
**SEER** — Seasonal Energy Efficiency Ratio  
**UI** — User Interface

# DETAILED COOLING CAPACITIES\* - COMFORT + DEHUMIDIFY MODE

EDB °F (°C)	EVAP. AIR EWB °F (°C)	25VNA024/FE4BNB006 Cooling COMFORT + DEHUMIDIFY MODE CONDENSER ENTERING AIR TEMPERATURES deg °F (°C)																																																																
		115 (46.1)			105 (40.5)			95 (35)			Total Sys. KW**	ID SCFM	Capacity MBtu/h†		Total Sys. KW**	ID SCFM	Capacity MBtu/h†		Total Sys. KW**																																															
		Total	Sens†	Total Sys. KW**	Total	Sens†	Total Sys. KW**	Total	Sens†	Total			Sens†	Total			Sens†																																																	
<b>MAXIMUM DEMAND</b>																																																																		
<b>75 (23.9)</b>	72 (22.2)	24.34	9.92	2.07	25.50	10.35	1.76	26.53	10.73	1.51	629	629	22.82	13.41	1.81	23.77	13.77	1.56	629	629	20.90	15.82	1.85	21.80	16.17	1.60	629	629	18.12	18.12	1.90	19.50	19.50	1.65	629	629	24.27	13.12	1.76	26.47	13.89	1.51	629	629	21.69	16.18	1.81	23.70	16.90	1.56	629	629	19.90	18.59	1.85	21.79	19.29	1.60	629	629	19.37	19.37	2.18	20.74	20.74	1.62
	67 (19.4)	21.75	13.00	2.13	22.82	13.41	1.81	23.77	13.77	1.56																																																								
	63 (17.2)	19.89	15.43	2.17	20.90	15.82	1.85	21.80	16.17	1.60																																																								
	57 (13.9)	18.12	18.12	2.21	18.86	18.86	1.90	19.50	19.50	1.65																																																								
	72 (22.2)	24.27	13.12	2.07	25.44	13.53	1.76	26.47	13.89	1.51																																																								
<b>80 (26.7)</b>	67 (19.4)	21.69	16.18	2.13	22.76	16.56	1.81	23.70	16.90	1.56	629	629	20.90	18.96	1.85	21.79	19.29	1.60	629	629	20.10	20.10	1.87	20.74	20.74	1.62																																								
	63 (17.2)	19.90	18.59	2.17	20.90	18.96	1.85	21.79	19.29	1.60																																																								
	57 (13.9)	19.37	19.37	2.18	20.10	20.10	1.87	20.74	20.74	1.62																																																								
	72 (22.2)	19.25	7.87	1.57	20.24	8.23	1.33	21.12	8.56	1.14			500	500	17.22	10.36	1.62	18.94			11.03	1.18	500	500	15.74	12.32	1.65	17.35	12.97	1.22	500	500	14.38	14.38	1.68	15.55	15.55	1.26																												
	67 (19.4)	17.17	12.93	1.62	20.18	10.80	1.33	21.06	11.11	1.14																																																								
63 (17.2)	15.75	14.88	1.65	18.07	13.26	1.38	18.89	13.56	1.18																																																									
57 (13.9)	15.39	15.39	1.66	16.01	16.01	1.43	17.34	15.50	1.22																																																									
72 (22.2)	19.20	10.45	1.57	20.18	10.80	1.33	21.06	11.11	1.14																																																									
<b>80 (26.7)</b>	67 (19.4)	17.17	12.93	1.62	20.18	10.80	1.33	21.06	11.11	1.14	500	500	15.75	14.88	1.65	16.56	16.56	1.24	500	500	15.39	15.39	1.66	16.56	16.56	1.24																																								
	63 (17.2)	15.39	15.39	1.66	16.01	16.01	1.43	16.56	16.56	1.24																																																								
	57 (13.9)	15.39	15.39	1.66	16.01	16.01	1.43	16.56	16.56	1.24																																																								
	72 (22.2)	14.70	6.25	1.11	15.56	6.54	0.94	16.34	6.81	0.80			500	500	13.12	8.79	1.15	14.61			9.34	0.83	500	500	11.99	10.80	1.17	13.39	11.34	0.86	500	500	11.59	11.59	1.18	12.67	12.67	0.88																												
	67 (19.4)	13.12	8.79	1.15	13.91	9.08	0.98	14.61	9.34	0.83																																																								
63 (17.2)	11.99	10.80	1.17	12.73	11.09	1.01	13.39	11.34	0.86																																																									
57 (13.9)	11.59	11.59	1.18	12.16	12.16	1.02	12.67	12.67	0.88																																																									
72 (22.2)	14.65	8.87	1.11	15.51	9.16	0.94	16.28	9.41	0.80																																																									
<b>80 (26.7)</b>	67 (19.4)	13.09	11.40	1.15	13.87	11.68	0.98	14.57	11.92	0.83	500	500	12.51	12.51	1.16	13.61	13.61	0.86	500	500	12.48	12.48	1.16	13.58	13.58	0.86																																								
	63 (17.2)	12.51	12.51	1.16	13.09	13.09	1.00	13.61	13.61	0.86																																																								
	57 (13.9)	12.48	12.48	1.16	13.06	13.06	1.00	13.58	13.58	0.86																																																								
	72 (22.2)	14.70	6.25	1.11	15.56	6.54	0.94	16.34	6.81	0.80																																																								
	67 (19.4)	13.12	8.79	1.15	13.91	9.08	0.98	14.61	9.34	0.83																																																								

See notes on pg. 30

# DETAILED COOLING CAPACITIES\* - COMFORT + DEHUMIDIFY MODE (CONT.)

EDB °F (°C)	EVAP. AIR EWB °F (°C)	25VNA024/FE4BNB006 Cooling COMFORT + DEHUMIDIFY MODE CONDENSER ENTERING AIR TEMPERATURES deg °F (°C)												
		85 (29.4)			75 (23.9)			65 (18.3)						
		ID SCFM	Capacity MBtuht		ID SCFM	Capacity MBtuht		Total Sys. KW	ID SCFM	Capacity MBtuht		Total Sys. KW		
	Total	Sens†		Total	Sens†		Total	Sens†	Total	Sens†		Total	Sens†	
<b>MAXIMUM DEMAND</b>														
<b>75 (23.9)</b>	72 (22.2)	27.75	11.22	1.28	28.86	11.66	1.06	682	28.86	11.66	1.06	29.82	12.03	0.87
	67 (19.4)	24.87	14.36	1.33	25.90	14.91	1.12	682	25.90	14.91	1.12	26.77	15.34	0.92
	63 (17.2)	22.83	16.85	1.37	23.78	17.48	1.16	682	23.78	17.48	1.16	24.60	17.95	0.96
	57 (13.9)	20.40	20.40	1.42	21.23	21.23	1.21	682	21.23	21.23	1.21	21.95	21.83	1.01
	72 (22.2)	27.67	14.48	1.28	28.79	15.02	1.06	682	28.79	15.02	1.06	29.74	15.45	0.87
<b>80 (26.7)</b>	67 (19.4)	24.80	17.61	1.33	25.83	18.24	1.12	682	25.83	18.24	1.12	26.71	18.73	0.92
	63 (17.2)	22.82	20.07	1.37	23.77	20.80	1.15	682	23.77	20.80	1.15	24.59	21.33	0.96
	57 (13.9)	21.67	21.67	1.39	22.53	22.53	1.18	682	22.53	22.53	1.18	23.23	23.23	0.99
<b>MEDIAN DEMAND</b>														
<b>75 (23.9)</b>	72 (22.2)	21.94	8.87	0.97	22.69	9.16	0.81	500	22.69	9.16	0.81	23.52	9.49	0.66
	67 (19.4)	19.69	11.32	1.02	20.37	11.59	0.86	500	20.37	11.59	0.86	21.13	11.98	0.71
	63 (17.2)	18.06	13.26	1.06	18.70	13.52	0.90	500	18.70	13.52	0.90	19.40	13.95	0.75
	57 (13.9)	16.06	16.06	1.10	16.59	16.39	0.95	500	16.59	16.39	0.95	17.23	16.89	0.80
	72 (22.2)	21.89	11.41	0.97	22.63	11.68	0.81	500	22.63	11.68	0.81	23.46	12.06	0.66
<b>80 (26.7)</b>	67 (19.4)	19.64	13.84	1.02	20.32	14.10	0.86	500	20.32	14.10	0.86	21.08	14.54	0.71
	63 (17.2)	18.05	15.77	1.06	18.68	16.01	0.90	500	18.68	16.01	0.90	19.38	16.49	0.75
	57 (13.9)	17.07	17.07	1.08	17.53	17.53	0.93	500	17.53	17.53	0.93	18.14	18.14	0.78
<b>MINIMUM DEMAND</b>														
<b>75 (23.9)</b>	72 (22.2)	17.06	7.07	0.69	17.73	7.31	0.58	500	17.73	7.31	0.58	18.36	7.53	0.47
	67 (19.4)	15.29	9.59	0.73	15.89	9.81	0.62	500	15.89	9.81	0.62	16.47	10.03	0.51
	63 (17.2)	14.01	11.58	0.76	14.58	11.80	0.65	500	14.58	11.80	0.65	15.09	12.00	0.54
	57 (13.9)	13.14	13.14	0.78	13.56	13.56	0.68	500	13.56	13.56	0.68	13.93	13.93	0.57
	72 (22.2)	17.01	9.66	0.69	17.67	9.88	0.58	500	17.67	9.88	0.58	18.29	10.09	0.47
<b>80 (26.7)</b>	67 (19.4)	15.24	12.16	0.73	15.85	12.37	0.62	500	15.85	12.37	0.62	16.42	12.57	0.51
	63 (17.2)	14.09	14.09	0.75	14.61	14.34	0.65	500	14.61	14.34	0.65	15.11	14.53	0.54
	57 (13.9)	14.06	14.06	0.75	14.49	14.49	0.65	500	14.49	14.49	0.65	14.88	14.88	0.55

See notes on pg. 30



# DETAILED COOLING CAPACITIES\* - COMFORT + DEHUMIDIFY MODE (CONT.)

EDB °F (°C)	EVAP. AIR EWB °F (°C)	25VNA036/FE4BNB006 Cooling COMFORT + DEHUMIDIFY MODE CONDENSER ENTERING AIR TEMPERATURES deg °F (°C)																
		115 (46.1)			105 (40.5)			95 (35)			Total Sys. KW**	ID SCFM	Capacity MBtu/h†	Total Sys. KW**	ID SCFM	Capacity MBtu/h†	Total Sys. KW**	
		Total	Sens†	Total Sys. KW**	Total	Sens†	Total Sys. KW**	Total	Sens†	Total Sys. KW**								Total
<b>MAXIMUM DEMAND</b>																		
<b>75 (23.9)</b>	72 (22.2)	33.87	13.86	3.05	36.51	14.98	2.67	38.95	16.02	2.36	<b>1077</b>	<b>1200</b>	32.88	20.28	2.73	35.13	21.92	2.41
	67 (19.4)	30.46	18.54	3.11	30.20	24.41	2.78	32.31	26.54	2.46								
	63 (17.2)	27.92	22.19	3.16	28.05	28.05	2.82	30.23	30.23	2.49								
	57 (13.9)	25.72	25.72	3.21	36.34	20.35	2.67	38.76	21.97	2.36								
	72 (22.2)	33.72	18.63	3.05	32.76	25.58	2.73	35.00	27.81	2.41								
<b>80 (26.7)</b>	67 (19.4)	30.35	23.26	3.11	30.28	29.61	2.78	32.46	32.22	2.45	<b>1077</b>	<b>1200</b>	27.95	26.86	3.16	32.46	32.22	2.45
	63 (17.2)	27.95	26.86	3.16	29.98	29.98	2.78	32.31	32.31	2.45								
	57 (13.9)	27.49	27.49	3.17	<b>MEDIAN DEMAND</b>													
<b>75 (23.9)</b>	72 (22.2)	24.83	10.30	1.93	26.62	11.08	1.67	28.25	11.79	1.48	<b>822</b>	<b>900</b>	22.23	14.04	1.99	23.87	15.22	1.73
	67 (19.4)	20.36	16.96	2.03	21.89	18.45	1.77	25.38	16.33	1.53								
	63 (17.2)	19.16	19.16	2.05	20.72	20.72	1.80	23.31	19.87	1.57								
	57 (13.9)	24.70	14.12	1.93	26.47	15.30	1.67	22.16	22.16	1.59								
	72 (22.2)	22.16	17.82	1.98	23.80	19.39	1.73	28.08	16.42	1.48								
<b>80 (26.7)</b>	67 (19.4)	20.56	20.54	2.02	22.21	22.21	1.76	25.30	20.87	1.53	<b>822</b>	<b>900</b>	20.51	20.51	2.02	23.76	23.76	1.56
	63 (17.2)	20.51	20.51	2.02	22.17	22.17	1.77	23.71	23.71	1.56								
	57 (13.9)	14.70	6.26	1.08	<b>MINIMUM DEMAND</b>													
<b>75 (23.9)</b>	72 (22.2)	14.70	6.26	1.08	15.55	6.56	0.93	16.29	6.81	0.79	<b>500</b>	<b>500</b>	13.15	8.86	1.11	14.63	9.39	0.83
	67 (19.4)	12.04	10.91	1.14	13.94	9.14	0.96	13.43	11.43	0.86								
	63 (17.2)	11.67	11.67	1.15	12.78	11.18	0.99	12.73	12.73	0.88								
	57 (13.9)	14.60	8.91	1.08	15.44	9.18	0.93	16.19	9.43	0.79								
	72 (22.2)	13.11	11.49	1.11	13.89	11.77	0.96	14.58	12.00	0.83								
<b>80 (26.7)</b>	67 (19.4)	12.57	12.57	1.13	13.15	13.15	0.98	13.66	13.66	0.85	<b>500</b>	<b>500</b>	12.54	12.54	1.13	13.64	13.64	0.86
	63 (17.2)	12.54	12.54	1.13	13.13	13.13	0.98	13.64	13.64	0.86								
	57 (13.9)	12.54	12.54	1.13	See notes on pg. 30													

# DETAILED COOLING CAPACITIES\* - COMFORT + DEHUMIDIFY MODE (CONT.)

EDB °F (°C)	EVAP. AIR EWB °F (°C)	25VNA036/FE4BNB006 Cooling COMFORT + DEHUMIDIFY MODE CONDENSER ENTERING AIR TEMPERATURES deg °F (°C)														
		85					75					65				
		ID SCFM	Capacity MBtuht		Total Sys. KW**	ID SCFM	Capacity MBtuht		Total Sys. KW	ID SCFM	Capacity MBtuht		Total Sys. KW**			
<b>MAXIMUM DEMAND</b>																
<b>75 (23.9)</b>	72 (22.2)	40.08	16.25	2.00	<b>1038</b>	42.25	17.12	1.72	<b>1145</b>	44.16	17.87	1.48				
	67 (19.4)	36.16	21.39	2.06		38.13	22.59	1.78		39.87	23.55	1.53				
	63 (17.2)	33.23	25.38	2.10		35.06	26.84	1.82		36.68	27.96	1.57				
	57 (13.9)	30.17	30.17	2.15		31.89	31.89	1.87		33.31	33.31	1.62				
	72 (22.2)	39.92	21.45	2.00		42.08	22.65	1.72		43.99	23.60	1.48				
<b>80 (26.7)</b>	67 (19.4)	36.05	26.52	2.06	<b>1104</b>	38.01	28.05	1.78	<b>1145</b>	39.75	29.21	1.53				
	63 (17.2)	33.22	30.48	2.10		35.06	32.26	1.82		36.68	33.58	1.57				
	57 (13.9)	32.11	32.11	2.11		33.93	33.93	1.83		35.44	35.44	1.59				
<b>MEDIAN DEMAND</b>																
<b>75 (23.9)</b>	72 (22.2)	27.95	11.31	1.27	<b>641</b>	29.28	11.84	1.07	<b>683</b>	30.46	12.30	0.89				
	67 (19.4)	25.11	14.51	1.32		26.33	15.17	1.13		27.41	15.71	0.94				
	63 (17.2)	23.07	17.03	1.36		24.21	17.79	1.17		25.21	18.40	0.99				
	57 (13.9)	20.63	20.63	1.42		21.63	21.63	1.23		22.50	22.38	1.05				
	72 (22.2)	27.85	14.59	1.27		29.18	15.25	1.07		30.36	15.78	0.89				
<b>80 (26.7)</b>	67 (19.4)	25.03	17.77	1.32	<b>667</b>	26.25	18.55	1.13	<b>683</b>	27.32	19.18	0.94				
	63 (17.2)	23.06	20.28	1.36		24.19	21.17	1.17		25.19	21.84	0.99				
	57 (13.9)	21.91	21.91	1.39		22.94	22.94	1.20		23.80	23.80	1.01				
<b>MINIMUM DEMAND</b>																
<b>75 (23.9)</b>	72 (22.2)	17.06	7.08	0.69	<b>500</b>	17.74	7.32	0.58	<b>500</b>	18.36	7.54	0.48				
	67 (19.4)	15.33	9.64	0.73		15.95	9.87	0.62		16.51	10.08	0.52				
	63 (17.2)	14.07	11.67	0.76		14.64	11.88	0.66		15.16	12.07	0.55				
	57 (13.9)	13.21	13.21	0.78		13.63	13.63	0.68		14.01	14.01	0.59				
	72 (22.2)	16.97	9.68	0.69		17.65	9.91	0.58		18.27	10.12	0.48				
<b>80 (26.7)</b>	67 (19.4)	15.27	12.24	0.73	<b>500</b>	15.89	12.45	0.62	<b>500</b>	16.45	12.64	0.52				
	63 (17.2)	14.16	14.16	0.75		14.67	14.45	0.66		15.17	14.63	0.55				
	57 (13.9)	14.13	14.13	0.76		14.56	14.56	0.66		14.95	14.95	0.56				

See notes on pg. 30

# DETAILED COOLING CAPACITIES\* - COMFORT + DEHUMIDIFY MODE (CONT.)

EDB °F (°C)	EVAP. AIR EWB °F (°C)	25VNA048/FE4BNB006 Cooling COMFORT + DEHUMIDIFY MODE CONDENSER ENTERING AIR TEMPERATURES deg °F (°C)																			
		115 (46.1)			105 (40.5)			95 (35)			Total Sys. KW**	ID SCFM	Capacity MBtu/h†		Total Sys. KW**	ID SCFM	Capacity MBtu/h†		Total Sys. KW**		
		Total	Sens†	Total Sys. KW**	Total	Sens†	Total Sys. KW**	Total	Sens†	Total			Sens†	Total			Sens†				
<b>MAXIMUM DEMAND</b>																					
<b>75 (23.9)</b>	72 (22.2)	45.25	18.24	4.18	48.35	19.46	3.77	51.33	20.63	3.40	<b>1088</b>	<b>1158</b>	<b>1228</b>	<b>1228</b>	<b>1228</b>	<b>1228</b>	<b>1228</b>	<b>1228</b>	<b>1228</b>	<b>1228</b>	
	67 (19.4)	40.77	23.54	4.17	43.59	25.12	3.75	46.31	26.66	3.38											
	63 (17.2)	37.51	27.68	4.16	40.12	29.55	3.74	42.64	31.38	3.37											
	57 (13.9)	33.54	33.54	4.16	35.89	35.89	3.74	38.16	38.16	3.36											
	72 (22.2)	45.12	23.65	4.18	48.22	25.23	3.77	51.19	26.76	3.40											
<b>80 (26.7)</b>	67 (19.4)	40.67	28.88	4.17	43.48	30.82	3.75	46.20	32.71	3.38	<b>1088</b>	<b>1158</b>	<b>1228</b>	<b>1228</b>	<b>1228</b>	<b>1228</b>	<b>1228</b>	<b>1228</b>	<b>1228</b>	<b>1228</b>	
	63 (17.2)	37.46	32.99	4.16	40.07	35.21	3.74	42.60	37.39	3.37											
	57 (13.9)	35.58	35.58	4.16	38.06	38.06	3.74	40.45	40.45	3.36											
<b>MEDIAN DEMAND</b>																					
<b>75 (23.9)</b>	72 (22.2)	32.03	12.92	3.09	34.80	14.03	2.75	37.56	15.13	2.44	<b>765</b>	<b>811</b>	<b>857</b>	<b>857</b>	<b>857</b>	<b>857</b>	<b>857</b>	<b>857</b>	<b>857</b>	<b>857</b>	<b>857</b>
	67 (19.4)	28.81	16.41	3.10	31.33	17.82	2.75	33.84	19.22	2.44											
	63 (17.2)	26.42	19.12	3.10	28.77	20.76	2.75	31.09	22.39	2.44											
	57 (13.9)	23.43	23.15	3.11	25.54	25.13	2.76	27.63	27.11	2.44											
	72 (22.2)	31.94	16.50	3.09	34.70	17.91	2.75	37.45	19.31	2.44											
<b>80 (26.7)</b>	67 (19.4)	28.74	19.96	3.10	31.25	21.65	2.75	33.75	23.35	2.44	<b>765</b>	<b>811</b>	<b>857</b>	<b>857</b>	<b>857</b>	<b>857</b>	<b>857</b>	<b>857</b>	<b>857</b>	<b>857</b>	<b>857</b>
	63 (17.2)	26.39	22.66	3.10	28.73	24.58	2.75	31.04	26.51	2.44											
	57 (13.9)	24.76	24.76	3.11	26.93	26.93	2.75	29.09	29.09	2.43											
<b>MINIMUM DEMAND</b>																					
<b>75 (23.9)</b>	72 (22.2)	23.55	9.53	2.08	25.20	10.19	1.80	26.77	10.81	1.57	<b>542</b>	<b>568</b>	<b>593</b>	<b>593</b>	<b>593</b>	<b>593</b>	<b>593</b>	<b>593</b>	<b>593</b>	<b>593</b>	<b>593</b>
	67 (19.4)	21.10	12.15	2.09	22.59	12.96	1.80	24.02	13.74	1.57											
	63 (17.2)	19.35	14.24	2.09	20.74	15.16	1.81	22.07	16.06	1.57											
	57 (13.9)	17.23	17.23	2.10	18.44	18.44	1.82	19.64	19.51	1.57											
	72 (22.2)	23.48	12.26	2.08	25.12	13.06	1.80	26.69	13.84	1.57											
<b>80 (26.7)</b>	67 (19.4)	21.04	14.87	2.08	22.52	15.83	1.80	23.96	16.75	1.57	<b>542</b>	<b>568</b>	<b>593</b>	<b>593</b>	<b>593</b>	<b>593</b>	<b>593</b>	<b>593</b>	<b>593</b>	<b>593</b>	<b>593</b>
	63 (17.2)	19.33	16.94	2.09	20.72	18.02	1.81	22.05	19.05	1.57											
	57 (13.9)	18.31	18.31	2.09	19.57	19.57	1.81	20.78	20.78	1.57											

See notes on pg. 30

# DETAILED COOLING CAPACITIES\* - COMFORT + DEHUMIDIFY MODE (CONT.)

EDB °F (°C)	EVAP. AIR EWB °F (°C)	25VNA048/FE4BNB006 Cooling COMFORT + DEHUMIDIFY MODE CONDENSER ENTERING AIR TEMPERATURES deg °F (°C)														
		85					75					65				
		ID SCFM	Capacity MBtuht		Total Sys. KW**	ID SCFM	Capacity MBtuht		Total Sys. KW	ID SCFM	Capacity MBtuht		Total Sys. KW**			
<b>MAXIMUM DEMAND</b>																
75 (23.9)	72 (22.2)	53.90	21.63	3.07	1268	56.26	22.55	2.74	1282	58.43	23.39	2.48				
	67 (19.4)	48.63	27.79	3.05	1268	50.77	28.81	2.70	1282	52.79	29.77	2.44				
	63 (17.2)	44.81	32.62	3.03	1268	46.81	33.72	2.68	1282	48.68	34.75	2.41				
	57 (13.9)	40.05	39.65	3.02	1268	41.83	40.96	2.66	1282	43.53	42.15	2.38				
	72 (22.2)	53.76	27.89	3.07	1268	56.12	28.92	2.74	1282	58.28	29.86	2.48				
80 (26.7)	67 (19.4)	48.52	33.97	3.05	1268	50.66	35.09	2.70	1282	52.68	36.14	2.44				
	63 (17.2)	44.76	38.76	3.03	1268	46.75	39.97	2.68	1282	48.62	41.10	2.41				
	57 (13.9)	42.27	42.27	3.02	1268	43.94	43.94	2.67	1282	45.50	45.50	2.39				
<b>MEDIAN DEMAND</b>																
75 (23.9)	72 (22.2)	40.20	16.19	2.17	896	42.56	17.12	1.91	915	44.99	18.10	1.69				
	67 (19.4)	36.23	20.53	2.16	896	38.34	21.55	1.90	915	40.56	22.71	1.67				
	63 (17.2)	33.30	23.89	2.15	896	35.26	25.00	1.89	915	37.31	26.30	1.66				
	57 (13.9)	29.62	28.89	2.15	896	31.37	30.16	1.88	915	33.22	31.67	1.65				
	72 (22.2)	40.09	20.62	2.17	896	42.44	21.66	1.91	915	44.88	22.81	1.69				
80 (26.7)	67 (19.4)	36.15	24.89	2.16	896	38.26	26.03	1.90	915	40.47	27.37	1.67				
	63 (17.2)	33.26	28.24	2.15	896	35.21	29.47	1.89	915	37.26	30.94	1.66				
	57 (13.9)	31.10	31.10	2.15	896	32.74	32.74	1.88	915	34.53	34.53	1.65				
<b>MINIMUM DEMAND</b>																
75 (23.9)	72 (22.2)	28.32	11.44	1.39	645	29.87	12.06	1.22	668	31.35	12.65	1.07				
	67 (19.4)	25.44	14.51	1.38	645	26.84	15.29	1.22	668	28.17	16.02	1.07				
	63 (17.2)	23.38	16.95	1.38	645	24.67	17.85	1.22	668	25.91	18.68	1.06				
	57 (13.9)	20.82	20.58	1.39	645	21.98	21.67	1.22	668	23.09	22.67	1.06				
	72 (22.2)	28.24	14.61	1.39	645	29.79	15.39	1.22	668	31.26	16.12	1.07				
80 (26.7)	67 (19.4)	25.37	17.66	1.38	645	26.76	18.60	1.22	668	28.09	19.47	1.07				
	63 (17.2)	23.35	20.08	1.38	645	24.65	21.14	1.22	668	25.88	22.12	1.06				
	57 (13.9)	21.97	21.97	1.38	645	23.18	23.18	1.22	668	24.31	24.31	1.06				

See notes on pg. 30

# DETAILED COOLING CAPACITIES\* - COMFORT + DEHUMIDIFY MODE (CONT.)

EDB °F (°C)	EVAP. AIR EWB °F (°C)	25VNA060/FE4BNB006 Cooling COMFORT + DEHUMIDIFY MODE CONDENSER ENTERING AIR TEMPERATURES deg °F (°C)																				
		115 (46.1)			105 (40.5)			95 (35)			Total Sys. KW**	ID SCFM	Capacity MBtu/h†		Total Sys. KW**							
		Total	Sens†	Total Sys. KW**	Total	Sens†	Total Sys. KW**	Total	Sens†	Total			Sens†									
<b>MAXIMUM DEMAND</b>																						
<b>75 (23.9)</b>	72 (22.2)	55.23	22.21	5.32	58.76	23.57	4.86	62.04	24.84	4.46	<b>1508</b>	<b>1508</b>	50.06	28.90	5.28	53.24	30.68	4.82	56.21	32.35	4.41	
	67 (19.4)	46.20	34.11	5.26	49.14	36.23	4.79	51.88	38.23	4.38												
	63 (17.2)	41.43	41.43	5.23	44.08	44.08	4.76	46.56	46.56	4.35												
	57 (13.9)	55.03	28.88	5.32	58.54	30.67	4.86	61.82	32.35	4.46												
	72 (22.2)	49.91	35.51	5.28	53.09	37.71	4.82	56.04	39.79	4.41												
<b>80 (26.7)</b>	67 (19.4)	46.13	40.68	5.26	49.07	43.20	4.79	51.81	45.61	4.38	<b>1508</b>	<b>1508</b>	63 (17.2)	43.92	43.92	46.71	46.71	4.78	49.33	49.33	4.37	
	57 (13.9)	40.02	16.17	3.57	42.71	17.24	3.20	45.27	18.26	2.86												
	72 (22.2)	36.18	20.87	3.57	38.63	22.22	3.19	40.95	23.53	2.86												
	67 (19.4)	33.33	24.53	3.57	35.61	26.11	3.19	37.77	27.65	2.85												
	63 (17.2)	29.74	29.74	3.57	31.76	31.76	3.19	33.74	33.62	2.85												
<b>80 (26.7)</b>	72 (22.2)	39.86	20.90	3.57	42.54	22.25	3.20	45.10	23.56	2.86	<b>1037</b>	<b>1037</b>	67 (19.4)	36.07	25.55	3.57	38.51	27.18	3.19	40.84	28.77	2.85
	63 (17.2)	33.27	29.19	3.57	35.55	31.05	3.19	37.71	32.87	2.85												
	57 (13.9)	31.55	31.55	3.57	33.67	33.67	3.19	35.71	35.71	2.85												
	72 (22.2)	18.77	4.79	1.87	25.17	10.19	1.67	26.73	10.82	1.51												
	67 (19.4)	21.16	12.26	1.87	22.67	13.07	1.68	24.10	13.85	1.51												
<b>75 (23.9)</b>	63 (17.2)	19.44	14.41	1.88	20.84	15.33	1.68	22.18	16.22	1.51	<b>593</b>	<b>593</b>	57 (13.9)	17.36	17.36	1.89	18.59	18.59	1.69	19.76	19.74	1.51
	72 (22.2)	23.42	12.31	1.87	25.08	13.12	1.67	26.64	13.89	1.51												
	67 (19.4)	21.09	15.04	1.87	22.60	15.99	1.68	24.02	16.90	1.51												
	63 (17.2)	19.41	17.17	1.88	20.82	18.24	1.68	22.15	19.27	1.51												
	57 (13.9)	18.47	18.47	1.89	19.74	19.74	1.69	20.95	20.95	1.51												
<b>MINIMUM DEMAND</b>																						

See notes on pg. 30

# DETAILED COOLING CAPACITIES\* - COMFORT + DEHUMIDIFY MODE (CONT.)

EDB °F (°C)	EVAP. AIR EWB °F (°C)	25VNA060/FE4BNB006 Cooling COMFORT + DEHUMIDIFY MODE CONDENSER ENTERING AIR TEMPERATURES deg °F (°C)											
		85				75				65			
		ID SCFM	Capacity MBtuht		Total Sys. KW**	ID SCFM	Capacity MBtuht		Total Sys. KW	ID SCFM	Capacity MBtuht		Total Sys. KW**
Total	Sens†		Total	Sens†			Total	Sens†					
<b>MAXIMUM DEMAND</b>													
<b>75 (23.9)</b>	72 (22.2)	64.48	25.76	4.02	<b>1515</b>	66.50	26.53	3.65	<b>1528</b>	68.16	27.17	3.38	
	67 (19.4)	58.40	33.27	3.97		60.29	34.06	3.59		61.92	34.75	3.30	
	63 (17.2)	53.94	39.14	3.93		55.71	39.93	3.55		57.32	40.65	3.25	
	57 (13.9)	48.34	47.68	3.90		49.93	48.56	3.50		51.38	49.33	3.19	
	72 (22.2)	64.26	33.28	4.02		66.28	34.04	3.65		67.92	34.67	3.38	
<b>80 (26.7)</b>	67 (19.4)	58.24	40.70	3.97	<b>1521</b>	60.14	41.47	3.59	<b>1528</b>	61.77	42.15	3.30	
	63 (17.2)	53.86	46.53	3.94		55.62	47.31	3.55		57.22	48.03	3.25	
	57 (13.9)	50.89	50.89	3.91		52.27	52.27	3.52		53.47	53.47	3.21	
<b>MEDIAN DEMAND</b>													
<b>75 (23.9)</b>	72 (22.2)	47.53	19.14	2.57	<b>1065</b>	49.19	19.79	2.36	<b>1093</b>	51.11	20.54	2.05	
	67 (19.4)	43.00	24.56	2.56		44.58	25.28	2.34		46.32	26.12	2.03	
	63 (17.2)	39.67	28.78	2.56		41.18	29.56	2.32		42.79	30.46	2.01	
	57 (13.9)	35.40	34.97	2.55		36.77	35.85	2.30		38.21	36.86	1.99	
	72 (22.2)	47.36	24.59	2.57		49.02	25.28	2.36		50.96	26.12	2.05	
<b>80 (26.7)</b>	67 (19.4)	42.88	29.94	2.56	<b>1076</b>	44.45	30.71	2.34	<b>1093</b>	46.20	31.62	2.03	
	63 (17.2)	39.60	34.14	2.56		41.11	34.97	2.32		42.72	35.94	2.01	
	57 (13.9)	37.34	37.34	2.55		38.55	38.55	2.31		39.89	39.89	1.99	
<b>MINIMUM DEMAND</b>													
<b>75 (23.9)</b>	72 (22.2)	28.31	11.45	1.32	<b>618</b>	29.87	12.08	1.16	<b>668</b>	31.33	12.66	1.02	
	67 (19.4)	25.53	14.62	1.32		26.94	15.40	1.16		28.26	16.12	1.01	
	63 (17.2)	23.50	17.11	1.33		24.80	18.01	1.16		26.03	18.83	1.01	
	57 (13.9)	20.95	20.81	1.33		22.12	21.89	1.16		23.22	22.87	1.01	
	72 (22.2)	28.21	14.67	1.32		29.77	15.45	1.16		31.22	16.16	1.02	
<b>80 (26.7)</b>	67 (19.4)	25.45	17.82	1.32	<b>618</b>	26.86	18.75	1.16	<b>668</b>	28.18	19.60	1.01	
	63 (17.2)	23.47	20.30	1.33		24.78	21.35	1.16		26.00	22.30	1.01	
	57 (13.9)	22.14	22.14	1.33		23.35	23.35	1.16		24.46	24.46	1.01	

See notes on pg. 30

# DETAILED COOLING CAPACITIES\*- EFFICIENCY MODE

25VNA024/FE4BNB006 Cooling EFFICIENCY Mode  
Condenser Entering Air Temperature ° F (° C)

EDB ° F (° C)	EVAP AIR EWB ° F (° C)	115			105			95		
		ID SCFM	Capacity MBtu/ht		ID SCFM	Capacity MBtu/ht		ID SCFM	Capacity MBtu/ht	
			Total	Sens†		Total	Sens†		Total	Sens†
		Total Sys. KW**			Total Sys. KW**			Total Sys. KW**		
<b>MAXIMUM DEMAND</b>										
75 (23.9)	72 (22.2)	25.08	10.37	2.07	26.71	11.07	1.76	28.19	11.70	1.53
	67 (19.4)	22.41	14.07	2.12	23.90	15.11	1.82	25.26	16.09	1.58
	63 (17.2)	20.49	16.96	2.17	21.89	18.28	1.86	23.15	19.52	1.61
	57 (13.9)	19.23	19.23	2.20	20.63	20.63	1.89	21.91	21.91	1.64
80 (26.7)	72 (22.2)	25.01	14.19	2.06	26.63	15.24	1.76	28.11	16.21	1.52
	67 (19.4)	22.35	17.84	2.12	23.85	19.22	1.81	25.20	20.52	1.57
	63 (17.2)	20.65	20.62	2.16	22.15	22.09	1.85	23.51	23.51	1.61
	57 (13.9)	20.60	20.60	2.16	22.09	22.09	1.85	23.45	23.45	1.61
<b>MEDIAN DEMAND</b>										
75 (23.9)	72 (22.2)	19.71	8.15	1.57	21.00	8.69	1.33	22.20	9.19	1.13
	67 (19.4)	17.63	11.02	1.61	18.81	11.78	1.37	19.91	12.50	1.18
	63 (17.2)	16.13	13.29	1.65	17.24	14.21	1.41	18.27	15.11	1.21
	57 (13.9)	15.08	15.08	1.67	16.15	16.15	1.44	17.15	17.15	1.24
80 (26.7)	72 (22.2)	19.65	11.12	1.56	20.93	11.86	1.33	22.12	12.58	1.13
	67 (19.4)	17.58	13.96	1.61	18.77	14.93	1.37	19.86	15.86	1.18
	63 (17.2)	16.24	16.14	1.64	17.35	17.29	1.41	18.40	18.36	1.21
	57 (13.9)	16.17	16.17	1.65	17.29	17.29	1.41	18.35	18.35	1.21
<b>MINIMUM DEMAND</b>										
75 (23.9)	72 (22.2)	14.70	6.25	1.11	15.56	6.54	0.95	16.34	6.81	0.81
	67 (19.4)	13.12	8.79	1.15	13.91	9.08	0.98	14.62	9.34	0.85
	63 (17.2)	11.99	10.80	1.17	12.73	11.09	1.01	13.39	11.34	0.87
	57 (13.9)	11.59	11.59	1.18	12.16	12.16	1.02	12.67	12.67	0.89
80 (26.7)	72 (22.2)	14.65	8.87	1.11	15.51	9.16	0.95	16.28	9.41	0.81
	67 (19.4)	13.09	11.40	1.15	13.87	11.68	0.98	14.58	11.92	0.84
	63 (17.2)	12.51	12.51	1.16	13.09	13.09	1.00	13.61	13.61	0.87
	57 (13.9)	12.48	12.48	1.16	13.06	13.06	1.00	13.58	13.58	0.87

See notes on pg. 30

# DETAILED COOLING CAPACITIES\* - EFFICIENCY MODE (CONT.)

25VNA024/FE4BNB006 Cooling EFFICIENCY Mode Condenser Entering Air Temperature ° F (° C)														
EDB ° F (° C)	EVAP AIR EWB ° F (° C)	85 (29.4)			75 (23.9)			65 (18.3)			Total Sys. KW**	ID SCFM	Capacity MBtu/h Total	Total Sys. KW**
		ID SCFM	Capacity MBtu/h Total	Sens†	ID SCFM	Capacity MBtu/h Total	Sens†	ID SCFM	Capacity MBtu/h Total	Sens†				
<b>75 (23.9)</b>	72 (22.2)	29.18	12.01	1.29	30.23	12.39	1.08	31.22	12.76	0.88	<b>900</b>	31.22	12.76	0.88
	67 (19.4)	26.18	16.24	1.34	27.13	16.65	1.13	28.04	17.04	0.93				
	63 (17.2)	24.01	19.55	1.38	24.89	19.98	1.17	25.73	20.40	0.97				
	57 (13.9)	22.43	22.43	1.41	23.13	23.13	1.20	23.80	23.80	1.01				
<b>80 (26.7)</b>	72 (22.2)	29.10	16.36	1.29	30.14	16.78	1.08	31.12	17.16	0.88	<b>900</b>	31.12	17.16	0.88
	67 (19.4)	26.12	20.53	1.34	27.06	20.95	1.13	27.97	21.38	0.93				
	63 (17.2)	24.14	23.76	1.38	25.00	24.23	1.17	25.82	24.69	0.97				
	57 (13.9)	23.96	23.96	1.38	24.69	24.69	1.17	25.38	25.38	0.98				
<b>MEDIAN DEMAND</b>														
<b>75 (23.9)</b>	72 (22.2)	23.54	9.82	0.97	24.43	10.13	0.81	25.37	10.50	0.66	<b>782</b>	25.37	10.50	0.66
	67 (19.4)	21.13	13.56	1.02	21.94	13.87	0.86	22.80	14.35	0.71				
	63 (17.2)	19.41	16.49	1.05	20.16	16.77	0.90	20.97	17.36	0.75				
	57 (13.9)	18.42	18.42	1.07	19.00	19.00	0.92	19.72	19.72	0.77				
<b>80 (26.7)</b>	72 (22.2)	23.46	13.63	0.97	24.35	13.93	0.81	25.29	14.42	0.66	<b>782</b>	25.29	14.42	0.66
	67 (19.4)	21.08	17.32	1.02	21.89	17.60	0.86	22.75	18.21	0.71				
	63 (17.2)	19.76	19.76	1.04	20.35	20.35	0.89	21.12	21.12	0.74				
	57 (13.9)	19.72	19.72	1.04	20.31	20.31	0.89	21.07	21.07	0.74				
<b>MINIMUM DEMAND</b>														
<b>75 (23.9)</b>	72 (22.2)	17.95	7.29	0.70	18.38	7.83	0.59	19.00	8.00	0.49	<b>631</b>	19.00	8.00	0.49
	67 (19.4)	15.55	10.13	0.74	16.49	11.11	0.63	17.04	11.17	0.53				
	63 (17.2)	14.26	12.38	0.77	15.16	13.70	0.66	15.66	13.67	0.56				
	57 (13.9)	13.62	13.62	0.78	14.70	14.70	0.68	15.01	15.01	0.57				
<b>80 (26.7)</b>	72 (22.2)	17.29	10.20	0.70	18.31	11.18	0.59	18.93	11.23	0.48	<b>631</b>	18.93	11.23	0.48
	67 (19.4)	15.51	13.02	0.74	16.47	14.43	0.63	17.01	14.38	0.53				
	63 (17.2)	14.65	14.65	0.76	15.79	15.79	0.65	16.11	16.11	0.55				
	57 (13.9)	14.62	14.62	0.76	15.76	15.76	0.65	16.08	16.08	0.55				

See notes on pg. 30



# DETAILED COOLING CAPACITIES\* - EFFICIENCY MODE (CONT.)

25VNA036/FE4BNB006 Cooling EFFICIENCY Mode Condenser Entering Air Temperature ° F (° C)																
EDB ° F (° C)	EVAP AIR EWB ° F (° C)	115			105			95			ID SCFM	Capacity MBtu/ht Total	Total Sys. KW**	Total Sys. KW**		
		ID SCFM	Capacity MBtu/ht Total	Sens†	ID SCFM	Capacity MBtu/ht Total	Sens†	ID SCFM	Capacity MBtu/ht Total	Sens†						
75 (23.9)	72 (22.2)	33.87	13.86	3.05	1077	36.51	14.98	2.67	1200	36.95	16.02	2.36	95	36.95	16.02	2.36
	67 (19.4)	30.46	18.54	3.11		32.88	20.28	2.73		35.13	21.92	2.41				
	63 (17.2)	27.92	22.19	3.16		30.20	24.41	2.78		32.31	26.54	2.46				
	57 (13.9)	25.72	25.72	3.21		28.05	28.05	2.82		30.23	30.23	2.49				
80 (26.7)	72 (22.2)	33.72	18.63	3.05	1077	36.34	20.35	2.67	1200	36.76	21.97	2.36	95	36.76	21.97	2.36
	67 (19.4)	30.35	23.26	3.11		32.76	25.58	2.73		35.00	27.81	2.41				
	63 (17.2)	27.95	26.86	3.16		30.28	29.61	2.78		32.46	32.22	2.45				
	57 (13.9)	27.49	27.49	3.17		29.98	29.98	2.78		32.31	32.31	2.45				
<b>MEDIAN DEMAND</b>																
75 (23.9)	72 (22.2)	24.83	10.30	1.93	822	26.62	11.08	1.67	900	26.25	11.79	1.48	95	26.25	11.79	1.48
	67 (19.4)	22.23	14.04	1.99		23.87	15.22	1.73		25.38	16.33	1.53				
	63 (17.2)	20.36	16.96	2.03		21.89	18.45	1.77		23.31	19.87	1.57				
	57 (13.9)	19.16	19.16	2.05		20.72	20.72	1.80		22.16	22.16	1.59				
80 (26.7)	72 (22.2)	24.70	14.12	1.93	822	26.47	15.30	1.67	900	26.08	16.42	1.48	95	26.08	16.42	1.48
	67 (19.4)	22.16	17.82	1.98		23.80	19.39	1.73		25.30	20.87	1.53				
	63 (17.2)	20.56	20.54	2.02		22.21	22.21	1.76		23.76	23.76	1.56				
	57 (13.9)	20.51	20.51	2.02		22.17	22.17	1.77		23.71	23.71	1.56				
<b>MINIMUM DEMAND</b>																
75 (23.9)	72 (22.2)	14.70	6.26	1.08	500	15.55	6.56	0.93	500	16.29	6.81	0.79	95	16.29	6.81	0.79
	67 (19.4)	13.15	8.86	1.11		13.94	9.14	0.96		14.63	9.39	0.83				
	63 (17.2)	12.04	10.91	1.14		12.78	11.18	0.99		13.43	11.43	0.86				
	57 (13.9)	11.67	11.67	1.15		12.24	12.24	1.00		12.73	12.73	0.88				
80 (26.7)	72 (22.2)	14.60	8.91	1.08	500	15.44	9.18	0.93	500	16.19	9.43	0.79	95	16.19	9.43	0.79
	67 (19.4)	13.11	11.49	1.11		13.89	11.77	0.96		14.58	12.00	0.83				
	63 (17.2)	12.57	12.57	1.13		13.15	13.15	0.98		13.66	13.66	0.85				
	57 (13.9)	12.54	12.54	1.13		13.13	13.13	0.98		13.64	13.64	0.86				

See notes on pg. 30

# DETAILED COOLING CAPACITIES\* - EFFICIENCY MODE (CONT.)

25VNA036/FE4BNB006 Cooling EFFICIENCY Mode Condenser Entering Air Temperature ° F (° C)															
EDB ° F (° C)	EVAP AIR EWB ° F (° C)	85 (29.4)			75 (23.9)			65 (18.3)			Total Sys. KW**	ID SCFM	Capacity MBtu/h		Total Sys. KW**
		ID SCFM	Total	Sens†	ID SCFM	Total	Sens†	ID SCFM	Total	Sens†			Total	Sens†	
<b>75 (23.9)</b>	72 (22.2)		40.15	16.29	2.00		42.69	17.37	1.75				45.07	18.39	1.56
	67 (19.4)		36.23	21.49	2.06		38.54	23.25	1.80				40.71	25.02	1.61
	63 (17.2)	1050	33.29	25.53	2.10	1190	35.44	27.84	1.84	1347			37.47	30.21	1.65
	57 (13.9)		30.27	30.27	2.15		32.58	32.58	1.88				34.87	34.87	1.68
<b>80 (26.7)</b>	72 (22.2)		39.99	21.55	2.00		42.51	23.30	1.75				44.87	25.06	1.56
	67 (19.4)		36.11	26.68	2.06	1190	38.41	29.11	1.80	1347			40.56	31.63	1.61
	63 (17.2)	1050	33.29	30.68	2.10		35.49	33.62	1.84				37.61	36.65	1.65
	57 (13.9)		32.23	32.23	2.11		34.75	34.75	1.85				37.20	37.20	1.65
<b>MEDIAN DEMAND</b>															
<b>75 (23.9)</b>	72 (22.2)		29.48	12.18	1.27		30.98	12.81	1.08				32.38	13.39	0.91
	67 (19.4)		26.50	16.59	1.33		27.87	17.48	1.14				29.16	18.33	0.96
	63 (17.2)	875	24.34	20.03	1.37	931	25.62	21.14	1.18	985			26.82	22.19	1.01
	57 (13.9)		22.85	22.85	1.40		24.08	24.08	1.21				25.24	25.24	1.04
<b>80 (26.7)</b>	72 (22.2)		29.32	16.66	1.27		30.82	17.55	1.08				32.21	18.39	0.91
	67 (19.4)		26.42	21.00	1.33		27.78	22.17	1.14				29.07	23.27	0.96
	63 (17.2)	875	24.51	24.32	1.36	931	25.79	25.68	1.18	985			27.03	26.92	1.00
	57 (13.9)		24.39	24.39	1.37		25.70	25.70	1.18				26.94	26.94	1.00
<b>MINIMUM DEMAND</b>															
<b>75 (23.9)</b>	72 (22.2)		17.92	7.30	0.69		18.35	7.84	0.59				18.96	8.00	0.48
	67 (19.4)		15.56	10.19	0.73		16.50	11.17	0.63				17.06	11.22	0.53
	63 (17.2)	562	14.31	12.47	0.76	650	15.20	13.79	0.66	650			15.70	13.76	0.56
	57 (13.9)		13.70	13.70	0.78		14.77	14.77	0.67				15.07	15.07	0.58
<b>80 (26.7)</b>	72 (22.2)		17.21	10.22	0.69		18.22	11.20	0.59				18.84	11.25	0.48
	67 (19.4)		15.51	13.10	0.73		16.46	14.51	0.63				17.01	14.45	0.53
	63 (17.2)	562	14.70	14.70	0.75	650	15.85	15.85	0.65	650			16.16	16.16	0.55
	57 (13.9)		14.67	14.67	0.75		15.82	15.82	0.65				16.13	16.13	0.55

See notes on pg. 30

# DETAILED COOLING CAPACITIES\* - EFFICIENCY MODE

25VNA048/FE4BNB006 Cooling EFFICIENCY Mode Condenser Entering Air Temperature ° F (° C)													
EDB ° F (° C)	EVAP AIR EWB ° F (° C)	115			105			95			Total Sys. KW**	Total Sys. KW**	
		ID SCFM	Capacity MBtu/ht Total	Sens†	ID SCFM	Capacity MBtu/ht Total	Sens†	ID SCFM	Capacity MBtu/ht Total	Sens†			
75 (23.9)	72 (22.2)	1334	46.68	18.96	4.28	1417	49.81	20.17	3.89	1500	52.80	21.33	3.54
	67 (19.4)		42.07	25.42	4.26		44.91	27.05	3.87		47.64	28.62	3.52
	63 (17.2)		38.69	30.49	4.25		41.33	32.45	3.86		43.84	34.35	3.51
	57 (13.9)		35.62	35.62	4.25		38.02	38.02	3.85		40.33	40.33	3.49
80 (26.7)	72 (22.2)	1334	46.54	25.52	4.28	1417	49.66	27.15	3.89	1500	52.65	28.71	3.54
	67 (19.4)		41.95	31.91	4.26		44.78	33.95	3.87		47.50	35.94	3.52
	63 (17.2)		38.73	36.87	4.25		41.38	39.23	3.86		43.90	41.52	3.51
	57 (13.9)		37.99	37.99	4.25		40.52	40.52	3.86		42.95	42.95	3.50
<b>MAXIMUM DEMAND</b>													
<b>MEDIAN DEMAND</b>													
75 (23.9)	72 (22.2)	1059	33.94	13.92	3.14	1122	36.83	15.07	2.82	1185	39.69	16.22	2.53
	67 (19.4)		30.53	18.75	3.15		33.16	20.30	2.81		35.77	21.85	2.52
	63 (17.2)		28.06	22.55	3.15		30.49	24.40	2.82		32.90	26.26	2.52
	57 (13.9)		26.00	26.00	3.16		28.23	28.23	2.82		30.45	30.45	2.52
80 (26.7)	72 (22.2)	1059	33.82	18.85	3.14	1122	36.70	20.39	2.82	1185	39.56	21.93	2.52
	67 (19.4)		30.44	23.62	3.15		33.06	25.55	2.81		35.66	27.49	2.52
	63 (17.2)		28.12	27.34	3.15		30.55	29.57	2.82		32.97	31.81	2.52
	57 (13.9)		27.78	27.78	3.15		30.14	30.14	2.82		32.49	32.49	2.52
<b>MINIMUM DEMAND</b>													
75 (23.9)	72 (22.2)	775	25.14	10.44	2.10	811	26.90	11.14	1.82	847	28.57	11.81	1.60
	67 (19.4)		22.51	14.24	2.10		24.11	15.14	1.83		25.64	16.03	1.60
	63 (17.2)		20.64	17.22	2.11		22.11	18.29	1.83		23.53	19.34	1.60
	57 (13.9)		19.45	19.45	2.11		20.78	20.78	1.83		22.07	22.07	1.60
80 (26.7)	72 (22.2)	775	25.04	14.34	2.10	811	26.78	15.24	1.82	847	28.45	16.12	1.60
	67 (19.4)		22.45	18.09	2.10		24.04	19.20	1.83		25.56	20.29	1.60
	63 (17.2)		20.87	20.82	2.11		22.27	22.22	1.83		23.81	23.24	1.60
	57 (13.9)		20.81	20.81	2.11		22.21	22.21	1.83		23.57	23.57	1.60

See notes on pg. 30

# DETAILED COOLING CAPACITIES\* - EFFICIENCY MODE (CONT.)

25VNA048/FE4BNB006 Cooling EFFICIENCY Mode Condenser Entering Air Temperature ° F (° C)													
EDB ° F (° C)	EVAP AIR EWB ° F (° C)	85 (29.4)			75 (23.9)			65 (18.3)					
		ID SCFM	Capacity MBtu/ht Total	Total Sys. KW**	ID SCFM	Capacity MBtu/ht Total	Total Sys. KW**	ID SCFM	Capacity MBtu/ht Total	Total Sys. KW**			
<b>75 (23.9)</b>	72 (22.2)	<b>1500</b>	55.37	22.28	3.20	<b>1534</b>	57.89	23.23	2.89	<b>1576</b>	60.28	24.14	2.66
	67 (19.4)		49.95	29.60	3.18		52.25	30.75	2.85		54.48	31.91	2.61
	63 (17.2)		46.01	35.36	3.16		48.14	36.66	2.83		50.22	38.00	2.58
	57 (13.9)		42.00	42.00	3.15		43.81	43.81	2.81		45.61	45.61	2.55
<b>80 (26.7)</b>	72 (22.2)	<b>1500</b>	55.22	29.70	3.20	<b>1534</b>	57.73	30.84	2.88	<b>1576</b>	60.11	31.97	2.66
	67 (19.4)		49.81	36.94	3.18		52.12	38.27	2.85		54.33	39.65	2.61
	63 (17.2)		46.03	42.59	3.16		48.16	44.09	2.83		50.22	45.66	2.58
	57 (13.9)		44.66	44.66	3.16		46.55	46.55	2.82		48.42	48.42	2.57
<b>MAXIMUM DEMAND</b>													
<b>75 (23.9)</b>	72 (22.2)	<b>1150</b>	42.08	17.09	2.23	<b>1238</b>	45.04	18.30	2.02	<b>1265</b>	47.67	19.32	1.81
	67 (19.4)		37.94	22.67	2.23		40.63	24.41	2.00		43.02	25.68	1.79
	63 (17.2)		34.89	27.03	2.22		37.38	29.19	1.99		39.59	30.66	1.77
	57 (13.9)		31.89	31.89	2.21		34.29	34.29	1.98		36.21	36.21	1.76
<b>80 (26.7)</b>	72 (22.2)	<b>1150</b>	41.94	22.76	2.23	<b>1238</b>	44.90	24.49	2.02	<b>1265</b>	47.52	25.76	1.81
	67 (19.4)		37.83	28.26	2.23		40.51	30.52	2.00		42.90	32.05	1.79
	63 (17.2)		34.91	32.57	2.22		37.42	35.23	1.99		39.63	36.95	1.77
	57 (13.9)		33.98	33.98	2.22		36.55	36.55	1.99		38.56	38.56	1.77
<b>MINIMUM DEMAND</b>													
<b>75 (23.9)</b>	72 (22.2)	<b>870</b>	30.17	12.43	1.42	<b>875</b>	31.63	12.98	1.25	<b>894</b>	33.11	13.56	1.11
	67 (19.4)		27.09	16.79	1.42		28.41	17.39	1.25		29.76	18.09	1.10
	63 (17.2)		24.87	20.21	1.41		26.09	20.85	1.25		27.34	21.65	1.10
	57 (13.9)		23.23	23.23	1.42		24.21	24.21	1.25		25.28	25.28	1.09
<b>80 (26.7)</b>	72 (22.2)	<b>870</b>	30.05	16.89	1.42	<b>875</b>	31.50	17.49	1.25	<b>894</b>	32.98	18.19	1.11
	67 (19.4)		27.01	21.19	1.42		28.32	21.84	1.25		29.67	22.67	1.10
	63 (17.2)		24.99	24.54	1.42		26.18	25.26	1.25		27.41	26.19	1.10
	57 (13.9)		24.79	24.79	1.41		25.81	25.81	1.25		26.94	26.94	1.10

See notes on pg. 30

# DETAILED COOLING CAPACITIES\* - EFFICIENCY MODE

25VNA060/FE4BNB006 Cooling EFFICIENCY Mode Condenser Entering Air Temperature ° F (° C)													
EDB ° F (° C)	EVAP AIR EWB ° F (° C)	115			105			95			Total Sys. KW**	Total Sys. KW**	
		ID SCFM	Capacity MBtu/ht Total	Sens†	ID SCFM	Capacity MBtu/ht Total	Sens†	ID SCFM	Capacity MBtu/ht Total	Sens†			
<b>75 (23.9)</b>	72 (22.2)	1300	55.12	22.16	5.31	1400	58.68	23.54	4.85	1500	62.00	24.82	4.45
	67 (19.4)	1300	49.96	28.77	5.28	1400	53.17	30.59	4.81	1500	56.16	32.30	4.41
	63 (17.2)	1300	46.11	33.91	5.25	1400	49.08	36.09	4.79	1500	51.85	38.15	4.38
	57 (13.9)	1300	41.28	41.28	5.22	1400	43.98	43.98	4.76	1500	46.50	46.50	4.35
<b>80 (26.7)</b>	72 (22.2)	1300	54.92	28.76	5.31	1400	58.47	30.59	4.85	1500	61.78	32.30	4.45
	67 (19.4)	1300	49.82	35.29	5.28	1400	53.02	37.56	4.81	1500	56.00	39.70	4.41
	63 (17.2)	1300	46.04	40.40	5.25	1400	49.01	43.02	4.79	1500	51.78	45.49	4.38
	57 (13.9)	1300	43.74	43.74	5.24	1400	46.59	46.59	4.77	1500	49.25	49.25	4.36
<b>MAXIMUM DEMAND</b>													
<b>75 (23.9)</b>	72 (22.2)	1192	41.61	17.05	3.63	1265	44.37	18.14	3.28	1338	46.98	19.16	2.96
	67 (19.4)	1192	37.68	23.11	3.63	1265	40.19	24.56	3.27	1338	42.55	25.93	2.95
	63 (17.2)	1192	34.75	27.85	3.63	1265	37.07	29.58	3.27	1338	39.27	31.23	2.95
	57 (13.9)	1192	32.25	32.25	3.63	1265	34.38	34.38	3.27	1338	36.38	36.38	2.94
<b>80 (26.7)</b>	72 (22.2)	1192	41.41	23.11	3.63	1265	44.16	24.55	3.28	1338	46.76	25.92	2.96
	67 (19.4)	1192	37.53	29.11	3.63	1265	40.04	30.90	3.27	1338	42.39	32.62	2.95
	63 (17.2)	1192	34.79	33.74	3.63	1265	37.12	35.81	3.27	1338	39.32	37.79	2.95
	57 (13.9)	1192	34.35	34.35	3.63	1265	36.59	36.59	3.27	1338	38.71	38.71	2.95
<b>MINIMUM DEMAND</b>													
<b>75 (23.9)</b>	72 (22.2)	775	16.15	1.63	2.08	811	26.68	11.10	1.82	847	28.33	11.75	1.59
	67 (19.4)	775	22.49	14.35	2.09	811	24.09	15.26	1.82	847	25.61	16.14	1.60
	63 (17.2)	775	20.68	17.44	2.10	811	22.18	18.50	1.83	847	23.59	19.53	1.60
	57 (13.9)	775	19.58	19.58	2.10	811	20.92	20.92	1.83	847	22.21	22.21	1.60
<b>80 (26.7)</b>	72 (22.2)	775	24.77	14.38	2.08	811	26.53	15.28	1.82	847	28.17	16.14	1.59
	67 (19.4)	775	22.42	18.29	2.09	811	24.01	19.40	1.82	847	25.52	20.47	1.60
	63 (17.2)	775	20.97	20.97	2.09	811	22.38	22.38	1.82	847	23.74	23.73	1.60
	57 (13.9)	775	20.93	20.93	2.09	811	22.34	22.34	1.83	847	23.69	23.69	1.60

See notes on pg. 30

# DETAILED COOLING CAPACITIES\* - EFFICIENCY MODE (CONT.)

25VNA060/FE4BNB006 Cooling EFFICIENCY Mode Condenser Entering Air Temperature ° F (° C)														
EDB ° F (° C)	EVAP AIR EWB ° F (° C)	85 (29.4)			75 (23.9)			65 (18.3)			ID SCFM	Capacity MBtu/h† Total	Sens†	Total Sys. KW**
		ID SCFM	Capacity MBtu/h† Total	Sens†	Total Sys. KW**	ID SCFM	Capacity MBtu/h† Total	Sens†	Total Sys. KW**	Capacity MBtu/h† Total				
<b>75 (23.9)</b>	72 (22.2)	64.39	25.72	4.01	<b>1500</b>	<b>1675</b>	67.43	26.88	3.76	<b>1877</b>	69.94	27.79	3.66	
	67 (19.4)	58.31	33.16	3.96			61.15	35.12	3.70		63.57	36.95	3.58	
	63 (17.2)	53.85	38.98	3.93			56.52	41.57	3.65		58.83	44.13	3.52	
	57 (13.9)	48.25	47.46	3.89			50.78	50.78	3.60		53.42	53.42	3.46	
<b>80 (26.7)</b>	72 (22.2)	64.17	33.17	4.01	<b>1500</b>	<b>1675</b>	67.19	35.08	3.76	<b>1877</b>	69.67	36.84	3.66	
	67 (19.4)	58.15	40.52	3.96			60.97	43.24	3.70		63.37	45.92	3.58	
	63 (17.2)	53.77	46.29	3.93			56.45	49.62	3.65		58.79	52.99	3.53	
	57 (13.9)	50.74	50.74	3.91			53.75	53.75	3.63		56.56	56.56	3.50	
<b>MAXIMUM DEMAND</b>														
<b>75 (23.9)</b>	72 (22.2)	49.14	19.93	2.66	<b>1320</b>	<b>1382</b>	51.12	20.71	2.48	<b>1416</b>	53.24	21.51	2.18	
	67 (19.4)	44.50	26.61	2.65			46.37	27.71	2.45		48.28	28.67	2.16	
	63 (17.2)	41.05	31.82	2.64			42.84	33.19	2.44		44.63	34.28	2.14	
	57 (13.9)	37.63	37.63	2.63			39.31	39.31	2.42		40.82	40.82	2.12	
<b>80 (26.7)</b>	72 (22.2)	48.93	26.60	2.66	<b>1320</b>	<b>1382</b>	50.90	27.67	2.48	<b>1416</b>	53.00	28.63	2.19	
	67 (19.4)	44.34	33.21	2.65			46.21	34.60	2.45		48.12	35.72	2.16	
	63 (17.2)	41.05	38.35	2.64			42.85	39.99	2.44		44.63	41.24	2.14	
	57 (13.9)	40.00	40.00	2.64			41.75	41.75	2.43		43.32	43.32	2.13	
<b>MINIMUM DEMAND</b>														
<b>75 (23.9)</b>	72 (22.2)	30.01	12.41	1.42	<b>870</b>	<b>875</b>	31.50	12.96	1.25	<b>894</b>	32.90	13.50	1.11	
	67 (19.4)	27.09	16.90	1.42			28.43	17.49	1.25		29.77	18.18	1.10	
	63 (17.2)	24.96	20.41	1.42			26.19	21.04	1.25		27.42	21.81	1.10	
	57 (13.9)	23.39	23.39	1.42			24.37	24.37	1.25		25.43	25.43	1.10	
<b>80 (26.7)</b>	72 (22.2)	29.84	16.92	1.42	<b>870</b>	<b>875</b>	31.33	17.52	1.25	<b>894</b>	32.81	18.21	1.11	
	67 (19.4)	27.00	21.37	1.42			28.33	22.00	1.25		29.67	22.81	1.10	
	63 (17.2)	25.07	24.80	1.42			26.26	25.50	1.25		27.49	26.40	1.10	
	57 (13.9)	24.93	24.93	1.42			25.96	25.96	1.25		27.06	27.06	1.10	

† Total and sensible capacities are net capacities. Blower motor heat has been subtracted.

‡ Sensible capacities shown are based on 80°F (27°C) entering air at the indoor coil. For sensible capacities at other than 80°F (27°C), deduct 835 Btu/h (245 kW) per 1000 CFM (480 L/S) of indoor coil air for each degree below 80°F (27°C), or add 835 Btu/h (245 kW) per 1000 CFM (480 L/S) of indoor coil air per degree above 80°F (27°C).

\*\* System kw is total of indoor and outdoor unit kilowatts.

# Detailed cooling capacities are based on indoor and outdoor unit at the same elevation per AHRI standard 210/240-08. If additional tubing length and/or indoor unit is located above outdoor unit, a slight variation in capacity may occur.

**NOTE:** When the required data falls between the published data, interpolation may be performed. Extrapolation is not an acceptable practice.

**EWB** — Entering Wet Bulb

# HEAT PUMP HEATING PERFORMANCE - COMFORT MODE

INDOOR AIR		25VNA024/FE4BNB006 Expanded Ratings Heating Comfort Mode OUTDOOR COIL ENTERING AIR TEMPERATURES deg ° F (° C)														
		-3 (-13.9)				7 (-13.9)				17 (-8.3)				27 (-2.8)		
EDB	ID SCFM	Capacity MBtuh		Total Sys. KwT	ID SCFM	Capacity MBtuh		Total Sys. KwT	ID SCFM	Capacity MBtuh		Total Sys. KwT	ID SCFM	Capacity MBtuh		Total Sys. KwT
		Total	Integ†			Total	Integ†			Total	Integ†			Total	Integ†	
65	500	15.72	14.46	2.52	500	20.31	18.66	2.90	500	23.77	21.67	2.83	621	24.60	21.85	2.43
70	500	15.92	14.10	2.60	500	19.93	18.31	3.00	576	23.46	21.39	2.97	621	24.35	21.63	2.57
75	500	14.88	13.69	2.67	500	19.51	17.93	3.09	500	23.12	21.08	3.10	621	24.08	21.39	2.71
<b>MAXIMUM</b>																
65	500	15.35	14.12	1.77	500	18.88	17.35	1.99	500	21.49	19.59	2.04	524	22.19	19.71	1.52
70	500	14.97	13.77	1.83	500	18.55	17.04	2.08	500	21.20	19.33	2.15	524	21.94	19.49	2.01
75	500	14.54	13.37	1.90	500	18.17	16.70	2.17	500	20.88	19.03	2.26	524	21.67	19.25	2.13
<b>MEDIAN</b>																
65	500	13.03	11.98	1.15	500	15.28	14.05	1.25	500	17.30	15.78	1.28	500	18.50	16.43	1.31
70	500	12.66	11.65	1.20	500	15.00	13.78	1.32	500	17.05	15.55	1.36	500	17.97	15.96	1.37
75	500	12.26	11.28	1.24	500	14.68	13.49	1.38	500	16.77	15.29	1.44	500	17.72	15.74	1.46
<b>MINIMUM</b>																

INDOOR AIR		25VNA024/FE4BNB006 Expanded Ratings Heating Comfort Mode OUTDOOR COIL ENTERING AIR TEMPERATURES deg ° F (° C)														
		37 (2.7)				47 (8.3)				57 (13.9)						
EDB	ID SCFM	Capacity MBtuh		Total Sys. KwT	ID SCFM	Capacity MBtuh		Total Sys. KwT	ID SCFM	Capacity MBtuh		Total Sys. KwT	ID SCFM	Capacity MBtuh		Total Sys. KwT
		Total	Integ†			Total	Integ†			Total	Integ†			Total	Integ†	
65	694	24.24	22.06	1.89	744	23.87	23.87	1.45	848	27.73	27.73	1.52	848	27.45	27.45	1.65
70	694	24.01	21.85	2.02	744	23.63	23.63	1.56	848	27.45	27.45	1.65	848	27.17	27.17	1.79
75	694	23.78	21.64	2.16	744	23.38	23.38	1.68	848	27.17	27.17	1.79	848	26.89	26.89	1.93
<b>MAXIMUM DEMAND</b>																
65	594	21.24	19.33	1.52	581	19.76	19.76	1.24	663	20.95	20.95	1.13	663	20.71	20.71	1.22
70	594	21.02	19.13	1.63	581	19.55	19.55	1.34	663	20.71	20.71	1.44	663	20.47	20.47	1.52
75	594	20.78	18.91	1.75	581	19.32	19.32	1.44	663	20.47	20.47	1.52	663	20.23	20.23	1.61
<b>MEDIAN DEMAND</b>																
65	500	17.52	15.94	1.16	500	16.09	16.09	1.00	500	18.50	18.50	0.89	500	19.32	19.32	0.96
70	500	15.91	14.48	1.12	500	13.24	13.24	0.85	500	16.09	16.09	0.89	500	15.32	15.32	0.89
75	500	15.69	15.69	1.20	500	13.05	13.05	0.92	500	15.32	15.32	0.96	500	14.21	14.21	0.89
<b>MINIMUM DEMAND</b>																

See notes on page 38

# HEAT PUMP HEATING PERFORMANCE - COMFORT MODE

INDOOR AIR		25VNA036/FE4BNB006 Expanded Ratings Heating Comfort Mode OUTDOOR COIL ENTERING AIR TEMPERATURES deg ° F (° C)														
		-3 (-19.4)				7 (-13.9)				17 (-8.3)				27 (-2.8)		
EDB	ID SCF M	Capacity MBtuh		Total Sys. KWt	ID SCF M	Capacity MBtuh		Total Sys. KWt	ID SCF M	Capacity MBtuh		Total Sys. KWt	Capacity MBtuh		Total Sys. KWt	
		Total	In-tegt			Total	In-tegt			Total	In-tegt		Total	In-tegt		
65		21.27	19.57	3.41		26.45	24.31	3.59		28.62	26.09	3.34		28.24	25.08	2.57
70	629	20.82	19.15	3.53	734	26.08	23.97	3.74	725	28.31	25.81	3.50		28.01	24.87	2.73
75		20.31	18.69	3.64		25.67	23.59	3.89		27.97	25.50	3.86		27.76	24.65	2.88
65		17.67	16.26	2.14		21.73	19.97	2.37		23.92	21.81	2.16		24.39	21.66	1.87
70	500	17.25	15.87	2.22	500	21.37	19.64	2.47	627	23.63	21.55	2.22		24.12	21.42	1.95
75		16.78	15.44	2.29		20.95	19.25	2.56		23.35	21.29	2.35		23.88	21.21	2.07
<b>MAXIMUM</b>																
65		12.89	11.86	1.12		15.13	13.91	1.23		17.16	15.65	1.26		18.38	16.32	1.16
70	500	12.55	11.55	1.17	500	14.86	13.66	1.29	500	16.92	15.43	1.34		18.16	16.13	1.39
75		12.16	11.19	1.21		14.56	13.38	1.36		16.66	15.19	1.42		17.92	15.92	1.48
<b>MEDIAN</b>																
<b>MINIMUM</b>																

INDOOR AIR		25VNA036/FE4BNB006 Expanded Ratings Heating Comfort Mode OUTDOOR COIL ENTERING AIR TEMPERATURES deg ° F														
		37 (2.7)				47 (8.3)				57 (13.9)						
EDB	ID SCFM	Capacity MBtuh		Total Sys. KWt	ID SCFM	Capacity MBtuh		Total Sys. KWt	ID SCFM	Capacity MBtuh		Total Sys. KWt	Capacity MBtuh		Total Sys. KWt	
		Total	In-tegt			Total	In-tegt			Total	In-tegt		Total	In-tegt		
65		26.87	24.45	1.93		33.65	33.65	2.12		38.34	38.34	2.04		38.34	38.34	2.04
70	978	26.63	24.24	2.06	1065	33.33	33.33	2.28	1255	37.96	37.96	2.20		37.96	37.96	2.20
75		26.39	24.01	2.20		33.01	33.01	2.44		37.57	37.57	2.37		37.57	37.57	2.37
<b>MAXIMUM DEMAND</b>																
65		23.39	21.29	1.81		21.63	21.63	1.26		21.79	21.79	1.10		21.79	21.79	1.10
70	543	22.99	20.92	1.63	766	21.43	21.43	1.39	862	21.58	21.58	1.20		21.58	21.58	1.20
75		22.77	20.72	1.74		21.22	21.22	1.49		21.36	21.36	1.30		21.36	21.36	1.30
<b>MEDIAN DEMAND</b>																
<b>MINIMUM DEMAND</b>																
65		17.43	15.86	1.16		16.02	16.02	0.99		15.24	15.24	0.89		15.24	15.24	0.89
70	500	17.23	15.68	1.25	500	15.83	15.83	1.07	500	15.06	15.06	0.97		15.06	15.06	0.97
75		17.03	15.49	1.33		15.64	15.64	1.16		14.87	14.87	1.05		14.87	14.87	1.05

See notes on page 38



# HEAT PUMP HEATING PERFORMANCE - COMFORT MODE

INDOOR AIR		-3 (-19.4)						7 (-13.9)						17 (-8.3)						27 (-2.8)					
		Capacity MBtuh		Total Sys. KwT		ID SCFM	Capacity MBtuh		Total Sys. KwT		ID SCFM	Capacity MBtuh		Total Sys. KwT		ID SCFM	Capacity MBtuh		Total Sys. KwT		ID SCFM	Capacity MBtuh		Total Sys. KwT	
EDB	ID SCFM	Total	Integ†	Total	Integ†	Total	ID SCFM	Total	Integ†	Total	ID SCFM	Total	Integ†	Total	ID SCFM	Total	Integ†	Total	Integ†	Total	ID SCFM	Total	Integ†	Total	
65	829	29.43	27.08	4.77	40.09	36.84	5.97	45.44	41.43	5.83	45.54	41.43	5.83	45.54	41.43	5.83	45.54	41.43	5.83	45.54	41.43	5.83	45.54	41.43	5.83
70		28.87	26.56	4.91	39.59	36.38	6.18	45.09	41.11	6.08	45.26	41.11	6.08	45.26	41.11	6.08	45.26	41.11	6.08	45.26	41.11	6.08	45.26	41.11	6.08
75		28.23	25.97	5.03	39.02	35.85	6.37	44.69	40.75	6.32	44.95	40.75	6.32	44.95	40.75	6.32	44.95	40.75	6.32	44.95	40.75	6.32	44.95	40.75	6.32
<b>MAXIMUM</b>																									
65	706	26.60	24.48	3.60	34.64	31.84	4.26	39.30	35.83	4.24	39.30	35.83	4.24	39.30	35.83	4.24	39.30	35.83	4.24	39.30	35.83	4.24	39.30	35.83	4.24
70		26.10	24.01	3.72	34.19	31.42	4.43	38.96	35.52	4.44	38.96	35.52	4.44	38.96	35.52	4.44	38.96	35.52	4.44	38.96	35.52	4.44	38.96	35.52	4.44
75		25.50	23.46	3.83	33.68	30.95	4.60	38.58	35.17	4.65	38.58	35.17	4.65	38.58	35.17	4.65	38.58	35.17	4.65	38.58	35.17	4.65	38.58	35.17	4.65
<b>MEDIAN</b>																									
65	583	21.58	19.86	2.51	25.66	23.58	2.71	29.61	27.00	2.79	29.61	27.00	2.79	29.61	27.00	2.79	29.61	27.00	2.79	29.61	27.00	2.79	29.61	27.00	2.79
70		21.14	19.45	2.60	25.31	23.26	2.84	29.33	26.74	2.94	29.33	26.74	2.94	29.33	26.74	2.94	29.33	26.74	2.94	29.33	26.74	2.94	29.33	26.74	2.94
75		20.83	18.98	2.69	24.92	22.90	2.96	29.02	26.46	3.09	29.02	26.46	3.09	29.02	26.46	3.09	29.02	26.46	3.09	29.02	26.46	3.09	29.02	26.46	3.09
<b>MINIMUM</b>																									
65		21.58	19.86	2.51	25.66	23.58	2.71	29.61	27.00	2.79	29.61	27.00	2.79	29.61	27.00	2.79	29.61	27.00	2.79	29.61	27.00	2.79	29.61	27.00	2.79
70		21.14	19.45	2.60	25.31	23.26	2.84	29.33	26.74	2.94	29.33	26.74	2.94	29.33	26.74	2.94	29.33	26.74	2.94	29.33	26.74	2.94	29.33	26.74	2.94
75		20.83	18.98	2.69	24.92	22.90	2.96	29.02	26.46	3.09	29.02	26.46	3.09	29.02	26.46	3.09	29.02	26.46	3.09	29.02	26.46	3.09	29.02	26.46	3.09

INDOOR AIR		37 (2.7)						47 (8.3)						57 (13.9)											
		Capacity MBtuh		Total Sys. KwT		ID SCFM	Capacity MBtuh		Total Sys. KwT		ID SCFM	Capacity MBtuh		Total Sys. KwT		ID SCFM	Capacity MBtuh		Total Sys. KwT		ID SCFM	Capacity MBtuh		Total Sys. KwT	
EDB	ID SCFM	Total	Integ†	Total	Integ†	Total	ID SCFM	Total	Integ†	Total	ID SCFM	Total	Integ†	Total	ID SCFM	Total	Integ†	Total	Integ†	Total	ID SCFM	Total	Integ†	Total	
65	1332	43.52	39.60	3.72	45.37	45.37	45.37	44.98	44.98	3.10	45.37	45.37	45.37	44.98	44.98	3.10	45.37	45.37	45.37	44.98	44.98	3.10	45.37	45.37	
70		43.20	39.31	3.92	44.98	44.98	44.98	44.59	44.59	3.28	44.98	44.98	44.98	44.59	44.59	3.28	44.98	44.98	44.98	44.59	44.59	3.28	44.98	44.98	
75		42.87	39.01	4.14	44.59	44.59	44.59	44.59	44.59	3.47	44.59	44.59	44.59	44.59	44.59	3.47	44.59	44.59	44.59	44.59	44.59	3.47	44.59	44.59	
<b>MAXIMUM DEMAND</b>																									
65	1000	37.44	34.07	2.96	32.81	32.81	32.81	32.53	32.53	2.20	32.81	32.81	32.81	32.53	32.53	2.20	32.81	32.81	32.81	32.53	32.53	2.20	32.81	32.81	
70		37.13	33.79	3.13	32.53	32.53	32.53	32.24	32.24	2.34	32.53	32.53	32.53	32.24	32.24	2.34	32.53	32.53	32.53	32.24	32.24	2.34	32.53	32.53	
75		36.83	33.52	3.31	32.24	32.24	32.24	32.24	32.24	2.48	32.24	32.24	32.24	32.24	32.24	2.48	32.24	32.24	32.24	32.24	32.24	2.48	32.24	32.24	
<b>MEDIAN DEMAND</b>																									
65		28.99	26.38	2.25	24.67	24.67	24.67	24.43	24.43	1.65	24.67	24.67	24.67	24.43	24.43	1.65	24.67	24.67	24.67	24.43	24.43	1.65	24.67	24.67	
70	639	28.74	26.15	2.39	24.43	24.43	24.43	24.18	24.18	1.75	24.43	24.43	24.43	24.18	24.18	1.75	24.43	24.43	24.43	24.18	24.18	1.75	24.43	24.43	
75		28.48	25.92	2.53	24.18	24.18	24.18	24.18	24.18	1.86	24.18	24.18	24.18	24.18	24.18	1.86	24.18	24.18	24.18	24.18	24.18	1.86	24.18	24.18	
<b>MINIMUM DEMAND</b>																									
65		28.99	26.38	2.25	24.67	24.67	24.67	24.43	24.43	1.65	24.67	24.67	24.67	24.43	24.43	1.65	24.67	24.67	24.67	24.43	24.43	1.65	24.67	24.67	
70		28.74	26.15	2.39	24.43	24.43	24.43	24.18	24.18	1.75	24.43	24.43	24.43	24.18	24.18	1.75	24.43	24.43	24.43	24.18	24.18	1.75	24.43	24.43	
75		28.48	25.92	2.53	24.18	24.18	24.18	24.18	24.18	1.86	24.18	24.18	24.18	24.18	24.18	1.86	24.18	24.18	24.18	24.18	24.18	1.86	24.18	24.18	

See notes on page 38

# HEAT PUMP HEATING PERFORMANCE - COMFORT MODE

INDOOR AIR		-3 (-19.4)						7 (-13.9)						17 (-8.3)						27 (-2.8)					
		Capacity MBtuh		Total Sys. KWt		ID SCFM	Capacity MBtuh		Total Sys. KWt		ID SCFM	Capacity MBtuh		Total Sys. KWt		ID SCFM	Capacity MBtuh		Total Sys. KWt		ID SCFM	Capacity MBtuh		Total Sys. KWt	
EDB		Total	Integ†	Total	Integ†		Total	Integ†	Total	Integ†		Total	Integ†	Total	Integ†		Total	Integ†	Total	Integ†	Total	Integ†	Total	Integ†	
65		35.26	32.44	5.55		42.64	39.19	6.14			52.51	47.88	6.89			56.52	50.20	6.38			65.52	50.20	6.38		
70	933	34.67	31.89	5.72	1011	42.17	38.76	6.36			52.21	47.60	6.98			56.18	49.89	6.67			65.18	49.89	6.67		
75		33.96	31.24	5.86		41.63	38.26	6.57			51.87	47.29	7.27			55.80	49.56	6.97			65.80	49.56	6.97		
<b>MAXIMUM</b>																									
65		31.33	28.83	3.66		37.25	34.23	4.08			44.24	40.33	4.43			47.67	42.33	4.25			56.67	42.33	4.25		
70	758	30.78	28.31	3.78	801	36.80	33.82	4.24			43.88	40.01	4.84			47.35	42.06	4.48			56.35	42.06	4.48		
75		30.13	27.72	3.89		36.29	33.35	4.40			43.49	39.65	4.85			47.03	41.77	4.70			56.03	41.77	4.70		
<b>MEDIAN</b>																									
65		23.59	21.70	2.13		27.53	25.30	2.38			31.22	28.46	2.52			34.47	30.81	2.23			41.47	30.81	2.23		
70	583	23.13	21.28	2.22	603	27.18	24.98	2.49			30.93	28.20	2.66			34.19	30.37	2.77			41.19	30.37	2.77		
75		22.80	20.79	2.29		26.78	24.61	2.60			30.62	27.92	2.80			33.90	30.11	2.93			41.11	30.11	2.93		
<b>MINIMUM</b>																									

INDOOR AIR		37 (2.7)						47 (8.3)						57 (13.9)											
		Capacity MBtuh		Total Sys. KWt		ID SCFM	Capacity MBtuh		Total Sys. KWt		ID SCFM	Capacity MBtuh		Total Sys. KWt		ID SCFM	Capacity MBtuh		Total Sys. KWt		ID SCFM	Capacity MBtuh		Total Sys. KWt	
EDB		Total	Integ†	Total	Integ†		Total	Integ†	Total	Integ†		Total	Integ†	Total	Integ†		Total	Integ†	Total	Integ†	Total	Integ†	Total	Integ†	
65		54.31	49.42	5.06		55.53	55.53	3.99			55.53	55.53	3.99			55.53	55.53	3.99			55.53	55.53	3.99		
70	1567	53.87	49.02	5.31	1575	55.04	55.04	4.21			55.04	55.04	4.21			55.04	55.04	4.21			55.04	55.04	4.21		
75		53.44	48.63	5.56		54.56	54.56	4.44			54.56	54.56	4.44			54.56	54.56	4.44			54.56	54.56	4.44		
<b>MAXIMUM DEMAND</b>																									
65		44.86	40.82	3.36		37.77	37.77	2.59			37.77	37.77	2.59			37.77	37.77	2.59			37.77	37.77	2.59		
70	1555	44.48	40.48	3.55	1101	37.42	37.42	2.75			37.42	37.42	2.75			37.42	37.42	2.75			37.42	37.42	2.75		
75		44.10	40.13	3.75		37.07	37.07	2.92			37.07	37.07	2.92			37.07	37.07	2.92			37.07	37.07	2.92		
<b>MEDIAN DEMAND</b>																									
65		30.81	27.59	2.23		24.40	24.40	1.62			24.40	24.40	1.62			24.40	24.40	1.62			24.40	24.40	1.62		
70	666	30.05	27.35	2.36	627	24.15	24.15	1.73			24.15	24.15	1.73			24.15	24.15	1.73			24.15	24.15	1.73		
75		29.79	27.11	2.50		23.90	23.90	1.83			23.90	23.90	1.83			23.90	23.90	1.83			23.90	23.90	1.83		
<b>MINIMUM DEMAND</b>																									

See notes on page 38

# HEAT PUMP HEATING PERFORMANCE - EFFICIENCY MODE

INDOOR AIR		25VNA024/FE4BNB006 Expanded Ratings Heating Efficiency Mode OUTDOOR COIL ENTERING AIR TEMPERATURES deg ° F (°C)														
		-3 (-19.4)			7 (-13.9)			17 (-8.3)			27 (-2.8)					
EDB	ID SCFM	Capacity MBtuh		Total Sys. KWt	ID SCFM	Capacity MBtuh		Total Sys. KWt	ID SCFM	Capacity MBtuh		Total Sys. KWt	ID SCFM	Capacity MBtuh		Total Sys. KWt
		Total	Integ†			Total	Integ†			Total	Integ†			Total	Integ†	
65	500	16.06	14.77	2.59	566	21.06	19.36	2.93	900	25.06	22.85	2.71	855	27.90	24.78	2.64
70	500	15.65	14.40	2.66	566	20.70	19.02	3.04	900	24.80	22.61	2.86	855	27.65	24.56	2.80
75	500	15.20	13.98	2.73	566	20.29	18.64	3.15	900	24.52	22.35	3.01	855	27.39	24.32	2.97
65	500	15.58	14.33	1.79	500	19.33	17.76	2.04	505	22.35	20.38	2.15	708	23.93	21.25	1.38
70	500	15.19	13.97	1.86	500	18.98	17.44	2.14	505	22.05	20.10	2.26	708	23.69	21.04	2.02
75	500	14.75	13.57	1.92	500	18.60	17.09	2.22	505	21.71	19.80	2.36	708	23.43	20.81	2.15
65	500	13.03	11.98	1.15	500	15.28	14.05	1.25	500	17.30	15.78	1.28	500	18.20	16.16	1.29
70	500	12.66	11.65	1.20	500	15.00	13.78	1.32	500	17.05	15.55	1.36	500	17.97	15.96	1.37
75	500	12.26	11.28	1.24	500	14.68	13.49	1.38	500	16.77	15.29	1.44	500	17.72	15.74	1.46

INDOOR AIR		25VNA024/FE4BNB006 Expanded Ratings Heating Efficiency Mode OUTDOOR COIL ENTERING AIR TEMPERATURES deg ° F														
		37 (2.7)			47 (8.3)			57 (13.9)								
EDB	ID SCFM	Capacity MBtuh		Total Sys. KWt	ID SCFM	Capacity MBtuh		Total Sys. KWt	ID SCFM	Capacity MBtuh		Total Sys. KWt	ID SCFM	Capacity MBtuh		Total Sys. KWt
		Total	Integ†			Total	Integ†			Total	Integ†			Total	Integ†	
65	900	26.19	23.84	1.95	900	23.85	23.85	1.36	900	27.73	27.73	1.49	900	27.45	27.45	1.62
70	900	25.95	23.61	2.09	900	23.60	23.60	1.47	900	27.45	27.45	1.62	900	27.17	27.17	1.75
75	900	25.70	23.39	2.24	900	23.35	23.35	1.59	900	27.17	27.17	1.75	900	26.92	26.92	1.88
65	889	21.61	19.67	1.38	817	18.45	18.45	1.00	817	20.52	20.52	1.00	817	20.28	20.28	1.09
70	889	21.40	19.47	1.49	817	18.23	18.23	1.09	817	20.28	20.28	1.09	817	20.03	20.03	1.19
75	889	21.18	19.27	1.60	817	18.02	18.02	1.18	817	20.03	20.03	1.19	817	19.78	19.78	1.28
65	500	16.11	14.66	1.04	750	13.49	13.49	0.70	750	14.46	14.46	0.71	750	14.26	14.26	0.77
70	500	15.91	14.48	1.12	750	13.30	13.30	0.77	750	14.26	14.26	0.77	750	14.06	14.06	0.85
75	500	15.69	15.69	1.20	750	13.10	13.10	0.83	750	14.06	14.06	0.85	750	13.86	13.86	0.92

See notes on page 38

# HEAT PUMP HEATING PERFORMANCE - EFFICIENCY MODE

INDOOR AIR		25VNA036/FE4BNB006 Expanded Ratings Heating Efficiency Mode OUTDOOR COIL ENTERING AIR TEMPERATURES deg ° F (° C)														
		-3 (-19.4)			7 (-13.9)			17 (-8.3)			27 (-2.8)					
EDB	ID SCFM	Capacity MBtuh		Total Sys. KWt	ID SCFM	Capacity MBtuh		Total Sys. KWt	ID SCFM	Capacity MBtuh		Total Sys. KWt	Capacity MBtuh		Total Sys. KWt	
		Total	Integ†			Total	Integ†			Total	Integ†		Total	Integ†		
65		21.39	19.88	3.35		27.41	25.19	3.60		31.88	29.07	3.46		32.55	28.91	2.98
70	720	20.97	19.29	3.48	922	27.07	24.88	3.76	1350	31.62	28.83	3.65	1289	32.31	28.69	3.16
75		20.49	18.95	3.60		26.69	24.52	3.93		31.34	28.57	3.84		32.06	28.47	3.34
<b>MAXIMUM</b>																
65		17.67	16.26	2.14		22.31	20.51	2.33		25.82	23.54	2.20		26.79	23.80	2.01
70	501	17.26	15.88	2.22	597	21.97	20.19	2.44	860	25.96	23.30	2.34	945	26.55	23.58	2.14
75		16.79	15.45	2.29		21.59	19.84	2.55		25.28	23.05	2.47		26.30	23.36	2.28
<b>MEDIAN</b>																
65		12.89	11.86	1.12		15.13	13.91	1.23		17.16	15.65	1.26		18.07	16.05	1.01
70	500	12.55	11.55	1.17	500	14.86	13.66	1.29	500	16.92	15.43	1.34	523	17.86	15.86	1.34
75		12.16	11.19	1.21		14.56	13.38	1.36		16.66	15.19	1.42		17.63	15.66	1.43
<b>MINIMUM</b>																

INDOOR AIR		25VNA036/FE4BNB006 Expanded Ratings Heating Efficiency Mode OUTDOOR COIL ENTERING AIR TEMPERATURES deg ° F														
		37 (2.7)			47 (8.3)			57 (13.9)								
EDB	ID SCFM	Capacity MBtuh		Total Sys. KWt	ID SCFM	Capacity MBtuh		Total Sys. KWt	ID SCFM	Capacity MBtuh		Total Sys. KWt	Capacity MBtuh		Total Sys. KWt	
		Total	Integ†			Total	Integ†			Total	Integ†		Total	Integ†		
65		29.24	26.61	2.12		33.72	33.72	2.07		38.39	38.39	2.03		38.39	2.03	
70	1142	28.99	26.38	2.26	1200	33.40	33.40	2.22	1300	38.00	38.00	2.19		38.00	2.19	
75		28.73	26.14	2.40		33.07	33.07	2.39		37.61	37.61	2.35		37.61	2.35	
<b>MAXIMUM DEMAND</b>																
65		24.02	21.86	1.52		20.56	20.56	1.13		21.48	21.48	1.03		21.48	1.03	
70	964	23.80	21.66	1.63	836	20.35	20.35	1.22	974	21.26	21.26	1.12		21.26	1.12	
75		23.58	21.46	1.75		20.14	20.14	1.32		21.04	21.04	1.22		21.04	1.22	
<b>MEDIAN DEMAND</b>																
65		16.03	14.59	1.01		13.48	13.48	0.70		14.46	14.46	0.71		14.46	0.71	
70	544	15.84	14.42	1.09	750	13.30	13.30	0.77	750	14.26	14.26	0.77		14.26	0.77	
75		15.64	14.23	1.17		13.11	13.11	0.83		14.07	14.07	0.85		14.07	0.85	
<b>MINIMUM DEMAND</b>																

See notes on page 38

# HEAT PUMP HEATING PERFORMANCE - EFFICIENCY MODE

INDOOR AIR	25VNA048/FE48NB006 Expanded Ratings Heating Efficiency Mode OUTDOOR COIL ENTERING AIR TEMPERATURES deg ° F (° C)															
	-3 (-19.4)				7 (-13.9)				17 (-8.3)				27 (-2.8)			
	ID SCFM	Capacity MBtuh		Total Sys. KWt	ID SCFM	Capacity MBtuh		Total Sys. KWt	ID SCFM	Capacity MBtuh		Total Sys. KWt	ID SCFM	Capacity MBtuh		Total Sys. KWt
	Total	Integ†			Total	Integ†			Total	Integ†			Total	Integ†		
<b>EDB</b>																
65	29.86	27.20	4.68		40.55	37.26	5.85		47.79	43.57	6.00		51.02	45.31	5.60	
70	29.06	26.74	4.84	1176	40.12	36.86	6.08	1600	47.50	43.31	6.27	1474	50.69	45.02	5.87	
75	28.48	26.20	4.98		39.61	36.40	6.29		47.16	43.00	6.54		50.35	44.72	6.14	
<b>MAXIMUM</b>																
65	26.71	24.57	3.52		34.88	32.05	4.16		40.55	36.97	4.26		43.27	38.43	3.92	
70	26.24	24.14	3.65	907	34.47	31.67	4.34	1101	40.22	36.67	4.47	1286	42.99	38.18	4.13	
75	25.70	23.65	3.77		34.01	31.25	4.52		39.86	36.34	4.68		42.69	37.92	4.35	
<b>MINIMUM</b>																
65	21.67	19.94	2.45		25.66	23.58	2.62		29.57	26.96	2.69		31.62	28.08	2.10	
70	21.26	19.56	2.55	689	25.35	23.29	2.75	800	29.30	26.71	2.84	859	31.36	27.85	2.70	
75	20.79	19.13	2.65		24.99	22.96	2.88		29.00	26.44	2.99		31.09	27.61	2.85	

INDOOR AIR	25VNA048/FE48NB006 Expanded Ratings Heating Efficiency Mode OUTDOOR COIL ENTERING AIR TEMPERATURES deg ° F											
	37 (2.7)				47 (8.3)				57 (13.9)			
	ID SCFM	Capacity MBtuh		Total Sys. KWt	ID SCFM	Capacity MBtuh		Total Sys. KWt	ID SCFM	Capacity MBtuh		Total Sys. KWt
	Total	Integ†			Total	Integ†			Total	Integ†		
<b>EDB</b>												
65	46.93	42.71	4.07		45.91	45.91	3.06		56.86	56.86	3.45	
70	46.58	42.39	4.28	1600	45.50	45.50	3.24	1600	56.33	56.33	3.64	
75	46.22	42.06	4.50		45.09	45.09	3.42		55.77	55.77	3.85	
<b>MAXIMUM DEMAND</b>												
65	39.94	36.34	2.99		33.12	33.12	2.08		36.52	36.52	2.09	
70	39.58	36.02	3.16	1275	32.81	32.81	2.21	1370	36.14	36.14	2.22	
75	39.24	35.71	3.34		32.50	32.50	2.35		35.77	35.77	2.35	
<b>MINIMUM DEMAND</b>												
65	28.98	26.37	2.10		25.07	25.07	1.44		27.55	27.55	1.47	
70	28.72	26.14	2.23	1125	24.80	24.80	1.53	1125	27.23	27.23	1.57	
75	28.46	25.90	2.36		24.52	24.52	1.64		26.92	26.92	1.67	

See notes on page 38

# HEAT PUMP HEATING PERFORMANCE - EFFICIENCY MODE

INDOOR AIR		25VNA060/FE4BNB006 Expanded Ratings Heating Efficiency Mode OUTDOOR COIL ENTERING AIR TEMPERATURES deg ° F (° C)														
		-3 (-19.4)			7 (-13.9)			17 (-8.3)			27 (-2.8)					
EDB	ID SCFM	Capacity MBtuh		Total Sys. KW†	ID SCFM	Capacity MBtuh		Total Sys. KW†	ID SCFM	Capacity MBtuh		Total Sys. KW†	Capacity MBtuh		Total Sys. KW†	
		Total	Integ‡			Total	Integ‡			Total	Integ‡		Total	Integ‡		
<b>MAXIMUM</b>																
65		35.44	32.61	5.46		42.75	39.28	5.99		52.80	48.14	6.63		56.64	50.30	6.34
70	1067	34.90	32.11	5.64	1155	42.32	38.89	6.22	1750	52.50	47.87	6.93	1662	56.30	50.00	6.63
75		34.27	31.53	5.80		41.83	38.44	6.45		52.19	47.58	7.23		55.94	49.68	6.93
<b>MEDIAN</b>																
65		31.48	28.96	3.58		37.31	34.28	3.95		44.28	40.37	4.29		47.77	42.43	4.17
70	867	30.97	28.49	3.72	916	36.90	33.91	4.12	1143	43.95	40.07	4.51	1342	47.46	42.15	4.39
75		30.37	27.94	3.84		36.44	33.49	4.29		43.58	39.73	4.72		47.14	41.87	4.62
<b>MINIMUM</b>																
65		23.63	21.74	2.07		27.55	25.32	2.30		31.24	28.48	2.43		34.52	30.66	2.08
70	667	23.21	21.35	2.16	689	27.23	25.03	2.41	800	30.96	28.23	2.57	945	34.24	30.41	2.62
75		22.72	20.90	2.24		26.87	24.69	2.53		30.66	27.96	2.71		33.96	30.16	2.78

INDOOR AIR		25VNA060/FE4BNB006 Expanded Ratings Heating Efficiency Mode OUTDOOR COIL ENTERING AIR TEMPERATURES deg ° F														
		37 (2.7)			47 (8.3)			57 (13.9)								
EDB	ID SCFM	Capacity MBtuh		Total Sys. KW†	ID SCFM	Capacity MBtuh		Total Sys. KW†	ID SCFM	Capacity MBtuh		Total Sys. KW†	Capacity MBtuh		Total Sys. KW†	
		Total	Integ‡			Total	Integ‡			Total	Integ‡		Total	Integ‡		
65		54.45	49.55	5.03		56.00	56.00	4.00		50.08	50.08	3.00		50.08	50.08	3.00
70	1649	54.03	49.17	5.28	1750	55.50	55.50	4.21	1725	49.57	49.57	3.17	49.04	49.04	49.04	3.33
75		53.59	48.77	5.54		54.99	54.99	4.44		39.22	39.22	2.40		38.76	38.76	2.54
65		44.69	40.87	3.36		38.45	38.45	2.51		38.45	38.45	2.40		38.32	38.32	2.69
70	1468	44.32	40.33	3.56	1478	38.07	38.07	2.67	1500	38.76	38.76	2.54	1125	38.76	38.76	2.54
75		43.95	40.00	3.76		37.69	37.69	2.83		26.98	26.98	1.51		26.61	26.61	1.61
65		30.39	27.66	2.08		25.08	25.08	1.43		24.80	24.80	1.53		24.51	24.51	1.71
70	814	30.14	27.42	2.21	1125	24.80	24.80	1.53	1125	24.51	24.51	1.63	1125	26.61	26.61	1.61
75		29.86	27.17	2.34		24.51	24.51	1.63		26.25	26.25	1.71		26.25	26.25	1.71

**NOTES:**

† The kW values include the compressor, outdoor fan motor, and indoor blower motor. The kW from supplement heaters should be added to these values to obtain Total Sys. kilowatts.

‡ The Btuh heating capacity values shown are net integrated values from which the defrost effect has been subtracted. The Btuh heating from supplement heaters should be added to those values to obtain Total Sys. capacity.

**NOTE:** When the required data falls between the published data, interpolation may be performed. Extrapolation is not an acceptable practice.

**EDB** — Entering Dry Bulb

## GUIDE SPECIFICATIONS

### GENERAL

#### System Description

Outdoor-mounted, air-cooled, split-system heat pump unit suitable for ground or rooftop installation. Unit consists of a hermetic compressor, an air-cooled coil, forward-swept blade propeller-type condenser fan, and a control box. Unit will discharge supply air upward as shown on contract drawings. Unit will be used in a refrigeration circuit to match up to a packaged fan coil or coil unit.

#### Quality Assurance

- Unit will be rated in accordance with the latest edition of AHRI Standard 240.
- Unit will be certified for capacity and efficiency, and listed in the latest AHRI directory.
- Unit construction will comply with latest edition of ASHRAE and with NEC.
- Unit will be constructed in accordance with UL standards and will carry the UL label of approval. Unit will have C-UL approval.
- Unit cabinet will be capable of withstanding Federal Test Method Standard No. 141 (Method 6061) 500-hr salt spray test.
- Air-cooled condenser coils are pressure tested and the outdoor units are leak tested.
- Unit constructed in ISO9001 approved facility.

#### Delivery, Storage, and Handling

- Unit will be shipped as single package only and is stored and handled per unit manufacturer's recommendations.

#### Warranty (for inclusion by specifying engineer)

- U.S. and Canada only.

### PRODUCTS

#### Equipment

- Factory-assembled, single-piece, air-cooled heat pump unit. Contained within the unit enclosure is all factory wiring, piping, controls, compressor, refrigerant charge Puron® (R-410A) refrigerant, and special features required prior to field start-up.

#### Unit Cabinet

- Unit cabinet will be constructed of galvanized steel, bonderized, and coated with a powder coat paint.

#### Fans

- Condenser fan will be direct-drive propeller type, forward swept blade, discharging air upward.

### AIR-COOLED, SPLIT-SYSTEM HEAT PUMP

25VNA0

2 TO 5 NOMINAL TONS

- Condenser fan motors will be totally enclosed, 1-phase type with class B insulation and permanently lubricated.
- Shafts will be corrosion resistant.
- Fan blades will be statically and dynamically balanced.
- Condenser fan openings will be equipped with coated steel wire safety guards.

#### Compressor

- Compressor will be hermetically sealed.
- Compressor will be mounted on rubber vibration isolators.
- Compressor will be covered with a sound absorbing blanket.

#### Condenser Coil

- Condenser coil will be air cooled.
- Coil will be constructed of aluminum fins mechanically bonded to copper tubes which are then cleaned, dehydrated, and sealed.

#### Refrigeration Components

- Refrigeration circuit components will include liquid-line front-seating shutoff valve with sweat connections, vapor-line front-seating shutoff valve with sweat connections, system charge of Puron® (R-410A) refrigerant, POE compressor oil, accumulator, charge compensator, electronic expansion valve, and reversing valve.
- Unit will be equipped with high-pressure switch, suction pressure transducer, and filter drier for Puron® refrigerant.

#### Operating Characteristics

- The capacity of the unit will meet or exceed \_\_\_\_\_ Btuh at a suction temperature of \_\_\_\_\_ °F (°C). The power consumption at full load will not exceed \_\_\_\_\_ kW.
- Combination of the unit and the evaporator or fan coil unit will have a total net cooling capacity of \_\_\_\_\_ Btuh or greater at conditions of \_\_\_\_\_ CFM entering air temperature at the evaporator at \_\_\_\_\_ °F (°C) wet bulb and \_\_\_\_\_ °F (°C) dry bulb, and air entering the unit at \_\_\_\_\_ °F (°C).
- The system will have a SEER of \_\_\_\_\_ Btuh/watt or greater at DOE conditions.

#### Electrical Requirements

- Nominal unit electrical characteristics will be \_\_\_\_\_ v, single phase, 60 hz. The unit will be capable of satisfactory operation within voltage limits of \_\_\_\_\_ v to \_\_\_\_\_ v.
- Unit electrical power will be single point connection.
- Control circuit will be 24v.

#### Special Features

- Refer to section of this literature identifying accessories and descriptions for specific features and available enhancements.
- Infinity control with appropriate software version is required for full featured operation.

## SYSTEM DESIGN SUMMARY

1. Intended for outdoor installation with free air inlet and outlet. Outdoor fan external static pressure available is less than 0.01-in. wc.
2. This product is qualified for low ambient cooling operation (below 55°F / 12.8°C) with an Infinity User Interface **ONLY**.
3. The maximum outdoor operating ambient in cooling mode is 125°F (51.67°C).
4. Minimum outdoor operating air temperature for heating mode is -15°F (-26.1°C).
5. Maximum outdoor operating air temperature for heating mode is 66°F (18.9°C).
6. For reliable operation, unit should be level in all horizontal planes.
7. For interconnecting refrigerant tube lengths greater than 80 ft (23.4 m) and/or elevation differences between indoor and outdoor units greater than 20 ft (6.1 m), consult Residential Piping and Longline Guideline and Service Manual available from equipment distributor.
8. If any refrigerant tubing is buried, provide a 6 in. (152.4 mm) vertical rise to the valve connections at the unit. Refrigerant tubing lengths up to 36 in. (914.4 mm) may be buried without further consideration. Do not bury refrigerant lines longer than 36 in. (914.4 mm).
9. Use only copper wire for electric connection at unit. Aluminum and clad aluminum are not acceptable for the type of connector provided.
10. Do not apply capillary tube indoor coils to these units.
11. Factory-supplied filter drier must be installed.